


BBR VT CONA CMI SP

Internal Post-tensioning System with 01 to 61 Strands

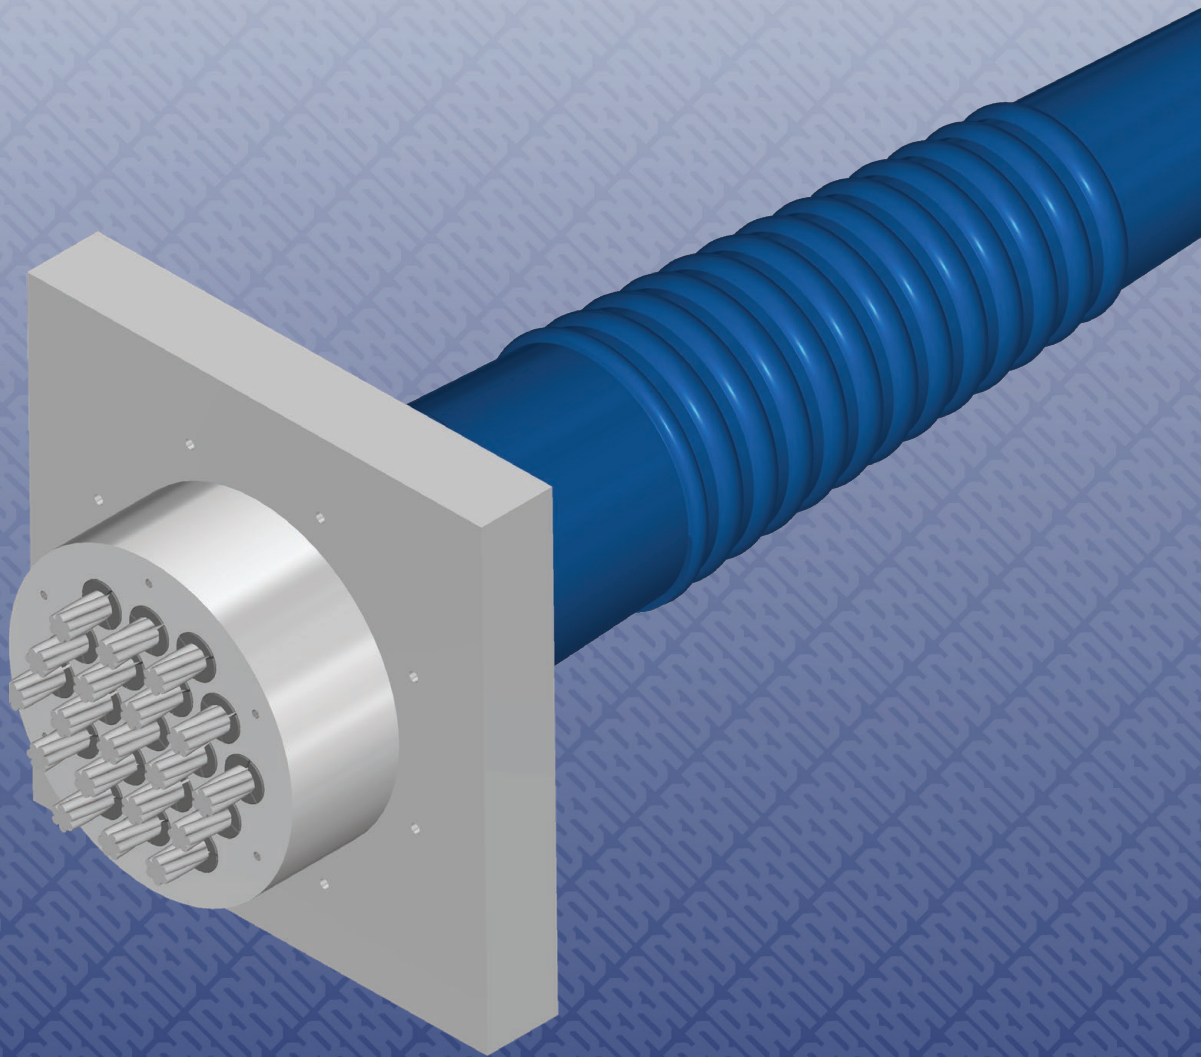


European Technical Assessment
ETA – 09/ 0287

CE



A Global Network of Experts
www.bbrnetwork.com

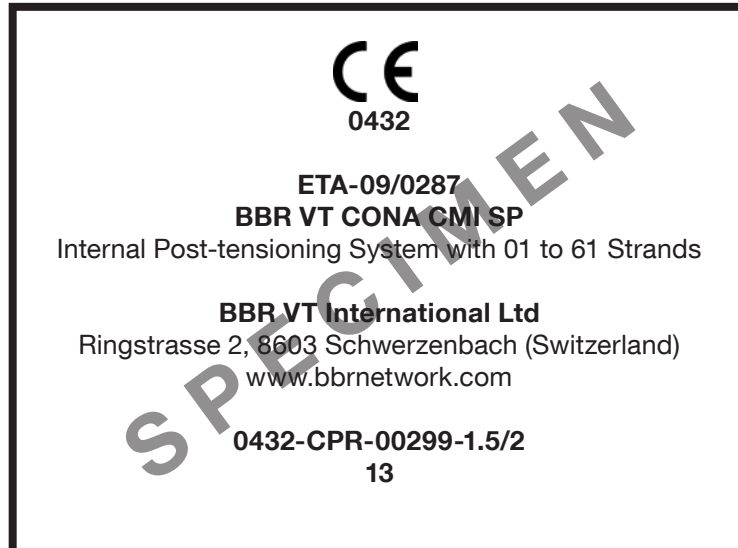

Responsible BBR PT Specialist Company



The delivery note accompanying components of the BBR VT CONA CMI SP Post-tensioning System will contain the CE marking.



Assembly and installation of BBR VT CONA CMI SP tendons must only be carried out by qualified BBR PT Specialist Companies. Find the local BBR PT Specialist Company by visiting the BBR Network website www.bbrnetwork.com.



European Organisation for Technical Approvals
Europäische Organisation für Technische Zulassungen
Organisation Européenne pour l'Agrément technique

ETAG 013

Guideline for European Technical Approval of Post-tensioning Kits for Prestressing of Structures

CWA 14646

Requirements for the installation of post-tensioning kits for prestressing of structures and qualification of the specialist company and its personnel



BBR E-Trace is the trading and quality assurance platform of the BBR Network linking the Holder of Approval, BBR VT International Ltd, BBR PT Specialist Companies and the BBR Manufacturing Plant. Along with the established BBR Factory Production Control, BBR E-Trace provides effective supply chain management including installation, delivery notes and highest quality standards, as well as full traceability of components.



Austrian Institute of Construction Engineering
Schenkenstrasse 4 | T+43 1 533 65 50
1010 Vienna | Austria | F+43 1 533 64 23
www.oib.or.at | mail@oib.or.at



European Technical Assessment

ETA-09/0287
of 19.09.2018

General part

Technical Assessment Body issuing the European Technical Assessment

Österreichisches Institut für Bautechnik (OIB)
Austrian Institute of Construction Engineering

Trade name of the construction product

BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands

Product family to which the construction product belongs

Bonded or unbonded post-tensioning kits for prestressing of structures with strands

Manufacturer

BBR VT International Ltd
Ringstrasse 2
8603 Schwerzenbach (ZH)
Switzerland

Manufacturing plant

BBR VT International Ltd
Ringstrasse 2
8603 Schwerzenbach (ZH)
Switzerland

This European Technical Assessment contains

62 pages including Annexes 1 to 35, which form an integral part of this assessment.

This European Technical Assessment is issued in accordance with Regulation (EU) № 305/2011, on the basis of

EAD 160004-00-0301, European Assessment Document for Post-Tensioning Kits for Prestressing of Structures.

This European Technical Assessment replaces

European technical approval ETA-09/0287 with validity from 30.06.2013 to 29.06.2018.

Table of contents

EUROPEAN TECHNICAL ASSESSMENT ETA-09/0287 OF 19.09.2018 1

GENERAL PART 1

TABLE OF CONTENTS 2

REMARKS 6

SPECIFIC PARTS 6

1 TECHNICAL DESCRIPTION OF THE PRODUCT 6

1.1 General 6

PT SYSTEM 7

1.2 Designation and range of anchorages and couplers 7

1.2.1 General 7

1.2.2 Designation 7

1.2.3 Anchorage, FA or SA 7

1.2.3.1 General 7

1.2.3.2 Restressable and exchangeable tendon 8

1.2.4 Fixed and stressing coupler 8

1.2.4.1 General 8

1.2.4.2 Single plane coupler, FK or SK 8

1.2.4.3 Sleeve coupler, FH or SH 8

1.2.5 Moveable coupler, BK or BH 8

1.2.6 Layout of the anchorage recess 9

1.3 Designation and range of the tendons 9

1.3.1 Designation 9

1.3.2 Range 9

1.3.2.1 General 9

1.3.2.2 CONA CMI SP n06-140 9

1.3.2.3 CONA CMI SP n06-150 10

1.4 Duct 10

1.4.1 Use of duct 10

1.4.2 Degree of filling 11

1.4.3 Circular steel strip sheath 11

1.4.4 Flat corrugated steel duct 11

1.4.5 Pre-bent smooth circular steel duct 11

1.5 Friction losses 11

1.6 Support of tendon 12

1.7 Slip at anchorage and coupler 12

1.8 Centre spacing and edge distance for the anchorage 13

1.9 Minimum radii of curvature 13

electronic copy

| | | |
|-----------|---|----|
| 1.10 | Concrete strength at time of stressing | 14 |
| | COMPONENTS..... | 14 |
| 1.11 | Prestressing steel strands | 14 |
| 1.12 | Anchorage and coupler | 15 |
| 1.12.1 | General..... | 15 |
| 1.12.2 | Anchor head..... | 15 |
| 1.12.3 | Square plate..... | 15 |
| 1.12.4 | Trumpet | 15 |
| 1.12.5 | Coupler anchor head..... | 16 |
| 1.12.6 | Ring wedge..... | 16 |
| 1.12.7 | Helix and additional reinforcement | 16 |
| 1.12.8 | Protection cap..... | 16 |
| 1.12.9 | Material specifications..... | 16 |
| 1.13 | Permanent corrosion protection..... | 17 |
| 2 | SPECIFICATION OF THE INTENDED USES IN ACCORDANCE WITH THE APPLICABLE EUROPEAN ASSESSMENT DOCUMENT (HEREINAFTER EAD) | 17 |
| 2.1 | Intended uses..... | 17 |
| 2.2 | Assumptions..... | 17 |
| 2.2.1 | General..... | 17 |
| 2.2.2 | Packaging, transport and storage..... | 18 |
| 2.2.3 | Design..... | 18 |
| 2.2.3.1 | General..... | 18 |
| 2.2.3.2 | Fixed and stressing coupler | 18 |
| 2.2.3.3 | Anchorage Recess | 18 |
| 2.2.3.4 | Maximum prestressing forces | 18 |
| 2.2.3.5 | Centre spacing, edge distance, and reinforcement in the anchorage zone | 18 |
| 2.2.3.6 | Tendons in masonry structures – load transfer to the structure..... | 19 |
| 2.2.4 | Installation..... | 19 |
| 2.2.4.1 | General..... | 19 |
| 2.2.4.2 | Stressing operation..... | 20 |
| 2.2.4.3 | Restressing..... | 20 |
| 2.2.4.4 | Exchanging tendons | 20 |
| 2.2.4.5 | Filling operations..... | 20 |
| 2.2.4.5.1 | Grouting | 20 |
| 2.2.4.5.2 | Filling with grease, wax, and an equivalent soft material..... | 21 |
| 2.2.4.5.3 | Circulating dry air..... | 21 |
| 2.2.4.5.4 | Filling records | 21 |
| 2.2.4.6 | Welding | 21 |
| 2.3 | Assumed working life | 21 |
| 3 | PERFORMANCE OF THE PRODUCT AND REFERENCES TO THE METHODS USED FOR ITS ASSESSMENT | 22 |
| 3.1 | Essential characteristics | 22 |
| 3.2 | Product performance..... | 23 |

| | | |
|----------------|--|-----------|
| 3.2.1 | Mechanical resistance and stability | 23 |
| 3.2.1.1 | Resistance to static load | 23 |
| 3.2.1.2 | Resistance to fatigue | 23 |
| 3.2.1.3 | Load transfer to the structure | 23 |
| 3.2.1.4 | Friction coefficient..... | 23 |
| 3.2.1.5 | Deviation, deflection (limits) for internal bonded and internal unbonded tendon | 23 |
| 3.2.1.6 | Assessment of assembly | 23 |
| 3.2.1.7 | Corrosion protection | 23 |
| 3.2.2 | Safety in case of fire..... | 24 |
| 3.2.2.1 | Reaction to fire | 24 |
| 3.2.3 | Hygiene, health and the environment..... | 24 |
| 3.2.3.1 | Content, emission and/or release of dangerous substances | 24 |
| 3.2.4 | Mechanical resistance and stability | 24 |
| 3.2.4.1 | Resistance to static load under cryogenic conditions for applications with anchorage/coupling outside the possible cryogenic zone..... | 24 |
| 3.3 | Assessment methods | 24 |
| 3.4 | Identification | 24 |
| 4 | ASSESSMENT AND VERIFICATION OF CONSTANCY OF PERFORMANCE (HEREINAFTER AVCP) SYSTEM APPLIED, WITH REFERENCE TO ITS LEGAL BASE..... | 25 |
| 4.1 | System of assessment and verification of constancy of performance | 25 |
| 4.2 | AVCP for construction products for which a European Technical Assessment has been issued..... | 25 |
| 5 | TECHNICAL DETAILS NECESSARY FOR THE IMPLEMENTATION OF THE AVCP SYSTEM, AS PROVIDED FOR IN THE APPLICABLE EAD | 25 |
| 5.1 | Tasks for the manufacturer..... | 25 |
| 5.1.1 | Factory production control..... | 25 |
| 5.1.2 | Declaration of performance | 26 |
| 5.2 | Tasks for the notified product certification body | 26 |
| 5.2.1 | Initial inspection of the manufacturing plant and of factory production control | 26 |
| 5.2.2 | Continuing surveillance, assessment and evaluation of factory production control | 26 |
| 5.2.3 | Audit-testing of samples taken by the notified product certification body at the manufacturing plant or at the manufacturer's storage facilities | 27 |
| ANNEXES | | 28 |
| ANNEX 1 | OVERVIEW ON ANCHORAGES AND COUPLERS..... | 28 |
| ANNEX 2 | ANCHORAGE AND COUPLER CONA CMI SP 0106..... | 29 |
| ANNEX 3 | ANCHOR HEADS | 30 |
| ANNEX 4 | COUPLER K AND TRUMPET K | 31 |
| ANNEX 5 | COUPLER H..... | 32 |
| ANNEX 6 | SQUARE PLATE AND TRUMPET A SP | 33 |
| ANNEX 7 | WEDGES AND ACCESSORIES..... | 34 |
| ANNEX 8 | TENDON RANGES FOR CONA CMI SP N06-140..... | 35 |
| ANNEX 9 | TENDON RANGES FOR CONA CMI SP N06-150..... | 36 |

| | | |
|----------|--|----|
| ANNEX 10 | MINIMUM RADIUS OF CURVATURE OF FLAT DUCT | 37 |
| ANNEX 11 | MINIMUM RADIUS OF CURVATURE OF CIRCULAR DUCT FOR $P_{R, MAX} = 200$ kN/M..... | 38 |
| ANNEX 12 | MINIMUM RADIUS OF CURVATURE OF CIRCULAR DUCT FOR $P_{R, MAX} = 140$ kN/M..... | 39 |
| ANNEX 13 | MINIMUM CENTRE SPACING..... | 40 |
| ANNEX 14 | MINIMUM EDGE DISTANCE..... | 41 |
| ANNEX 15 | MATERIAL SPECIFICATIONS..... | 42 |
| ANNEX 16 | MAXIMUM PRESTRESSING AND OVERSTRESSING FORCES | 43 |
| ANNEX 17 | CONSTRUCTION STAGES..... | 44 |
| ANNEX 18 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 45 |
| ANNEX 19 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 46 |
| ANNEX 20 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 47 |
| ANNEX 21 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 48 |
| ANNEX 22 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 49 |
| ANNEX 23 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 50 |
| ANNEX 24 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 51 |
| ANNEX 25 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 52 |
| ANNEX 26 | MINIMUM CONCRETE STRENGTH – HELIX – ADDITIONAL REINFORCEMENT – CENTRE SPACING AND EDGE DISTANCE – SQUARE PLATE DIMENSIONS | 53 |
| ANNEX 27 | MODIFICATION OF CENTRE SPACING AND EDGE DISTANCE..... | 54 |
| ANNEX 28 | DESCRIPTION OF INSTALLATION | 55 |
| ANNEX 29 | DESCRIPTION OF INSTALLATION | 56 |
| ANNEX 30 | PRESTRESSING STEEL STRAND SPECIFICATIONS | 57 |
| ANNEX 31 | CONTENTS OF THE PRESCRIBED TEST PLAN..... | 58 |
| ANNEX 32 | AUDIT TESTING | 59 |
| ANNEX 33 | ESSENTIAL CHARACTERISTICS FOR THE INTENDED USES..... | 60 |
| ANNEX 34 | REFERENCE DOCUMENTS | 61 |
| ANNEX 35 | REFERENCE DOCUMENTS | 62 |

Remarks

Translations of the European Technical Assessment in other languages shall fully correspond to the original issued document and should be identified as such.

Communication of the European Technical Assessment, including transmission by electronic means, shall be in full. However, partial reproduction may be made with the written consent of Österreichisches Institut für Bautechnik. Any partial reproduction has to be identified as such.

Specific parts

1 Technical description of the product

1.1 General

The European Technical Assessment¹ – ETA – applies to a kit, the PT system

BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands,

comprising the following components, see Annex 1, Annex 2, Annex 3, Annex 4, Annex 5, Annex 6, and Annex 7.

– Tendon

Internal tendon with 01 to 61 tensile elements

– Tensile element

7-wire prestressing steel strand with nominal diameters and maximum characteristic tensile strength as given in Table 1

Table 1 Tensile elements

| Nominal diameter | Nominal cross-sectional area | Maximum characteristic tensile strength |
|------------------|------------------------------|---|
| mm | mm ² | MPa |
| 15.3 | 140 | 1 860 |
| 15.7 | 150 | |

NOTE 1 MPa = 1 N/mm²

– Anchorage and coupler

Anchorage of the prestressing steel strands with ring wedges

End anchorage

Fixed (passive) anchor or stressing (active) anchor as end anchorage, FA or SA, for tendons with 01, 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, 31, 37, 42, 43, 48, 55 and 61 prestressing steel strands

¹ ETA-09/0287 was firstly issued in 2010 as European technical approval with validity from 17.05.2010, amended in 2010 with validity from 29.09.2010, extended in 2013 with validity from 30.06.2013, and converted in 2018 to European Technical Assessment ETA-09/0287 of 19.09.2018.

Fixed or stressing coupler

Single plane coupler, FK or SK, for tendons with 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, and 31 prestressing steel strands

Sleeve coupler, FH or SH, for tendons with 01, 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, 31, 37, 42, 43, 48, 55 and 61 prestressing steel strands

Moveable coupler

Single plane coupler, BK, for tendons with 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, and 31 prestressing steel strands

Sleeve coupler, BH, for tendons with 01, 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, 31, 37, 42, 43, 48, 55 and 61 prestressing steel strands

- Square plate for tendons with 01, 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, 31, 37, 42, 43, 48, 55 and 61 prestressing steel strands
- Helix and additional reinforcement in the region of the anchorage
- Corrosion protection for tensile elements, anchorages, and couplers

PT system


1.2 Designation and range of anchorages and couplers

1.2.1 General


End anchorages can be fixed or stressing anchorages. Couplers are fixed, stressing, or moveable. The principal dimensions of anchorages and couplers are given in Annex 2, Annex 3, Annex 4, Annex 5, Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26.

1.2.2 Designation

End anchorage e.g.

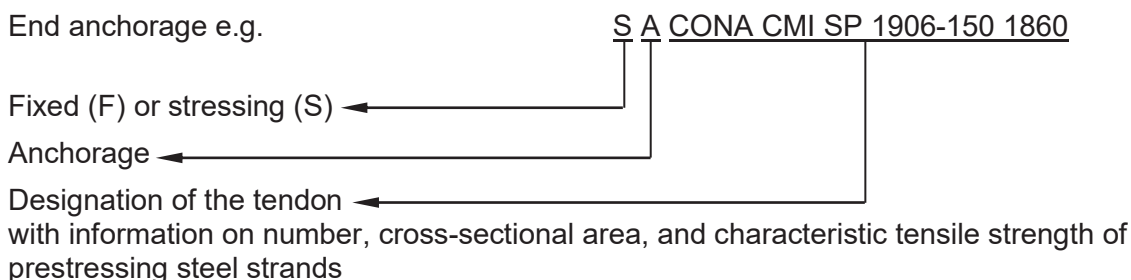

Coupler e.g.

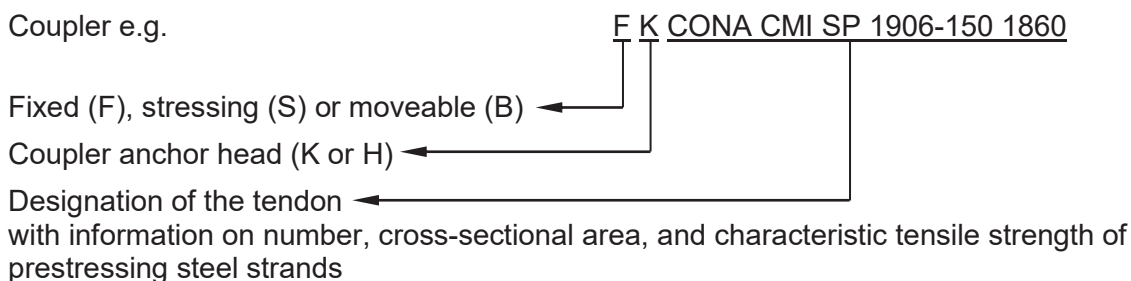

1.2.3 Anchorage, FA or SA

1.2.3.1 General

Anchorage of prestressing steel strands is achieved by wedges and anchor heads, see Annex 1, Annex 2, Annex 3, and Annex 7. The anchor heads of the fixed and stressing anchorage are identical. A differentiation is needed for the construction works.

The wedges of inaccessible fixed anchors are secured with either a wedge retaining plate or springs and a wedge retaining plate. An alternative is pre-locking each individual prestressing steel strand with $\sim 0.5 \cdot F_{pk}$ and applying a wedge retaining plate.

Where

F_{pk} Characteristic value of maximum force of one single prestressing steel strand

1.2.3.2 Restressable and exchangeable tendon

Significant to a restressable and exchangeable tendon is the excess length of the prestressing steel strands, see Annex 1. The extent of the excess length depends on the jack used for restressing or releasing. The protrusions of the prestressing steel strands require a permanent corrosion protection and an adapted cap.

1.2.4 Fixed and stressing coupler

1.2.4.1 General

Anchorage of prestressing steel strands is achieved by wedges and coupler anchor heads, see Annex 1, Annex 2, Annex 4, Annex 5, and Annex 7.

1.2.4.2 Single plane coupler, FK or SK

The coupling is achieved by means of a coupler anchor head K. The prestressing steel strands of the first construction stage are anchored by means of wedges in machined cones, drilled in parallel. The arrangement of the cones of the first construction stage is identical to that of the anchor head of a fixed or stressing anchorage. The prestressing steel strands of the second construction stage are anchored in a circle around the cones of the first construction stage by means of wedges in machined cones, drilled at an inclination of 7° . The wedges for the second construction stage are secured by means of holding springs and a cover plate.

1.2.4.3 Sleeve coupler, FH or SH

The coupler anchor head H is of the same basic geometry as the anchor head of the fixed or stressing anchorage. Compared to the anchor head of the fixed or stressing anchorage, the coupler anchor head H is higher and provide an external thread for the coupler sleeve. The wedges for the second construction stage are secured by means of a wedge retaining plate.

The connection between the coupler anchor heads H of the first and second construction stages is achieved by means of a coupler sleeve.

1.2.5 Moveable coupler, BK or BH

Anchorage of prestressing steel strands is achieved by wedges and coupler anchor heads, see Annex 1, Annex 2, Annex 4, Annex 5, and Annex 7. The moveable coupler is either a single plane coupler or a sleeve coupler in a coupler sheathing made of steel or plastic. Length and position of the coupler sheathing are for the expected elongation displacement, see Clause 2.2.4.

The coupler anchor heads and the coupler sleeve of the moveable coupler are identical to the coupler anchor heads and the coupler sleeve of the fixed or stressing coupler. The wedges for the first construction stage are secured by means of a wedge retaining plate and the wedges of the second construction stage are secured by wedge retaining plate or holding springs and cover plate.

A 100 mm long and at least 3.5 mm thick PE-HD insert is installed at the deviating point at the end of the trumpet. The insert is not required for plastic trumpets where the ducts are slipped over the plastic trumpet.

1.2.6 Layout of the anchorage recess

All bearing trumplates, anchor heads, and coupler anchor heads are placed perpendicular to the axis of the tendon, see Annex 17.


The dimensions of the anchorage recess are adapted to the prestressing jacks used. The ETA holder saves for reference information on the minimum dimensions of the anchorage recess.

The formwork for the anchorage recess should be slightly conical for ease of removal. In case of an internal anchorage fully embedded in concrete, the recess is designed so as to permit a reinforced concrete cover with the required dimensions and in any case with a thickness of at least 20 mm. In case of an exposed anchorage, see Annex 17, concrete cover on anchorage and square plate is not required. However, the exposed surfaces of square plate and steel cap are provided with corrosion protection.

1.3 Designation and range of the tendons

1.3.1 Designation

Tendon e.g.

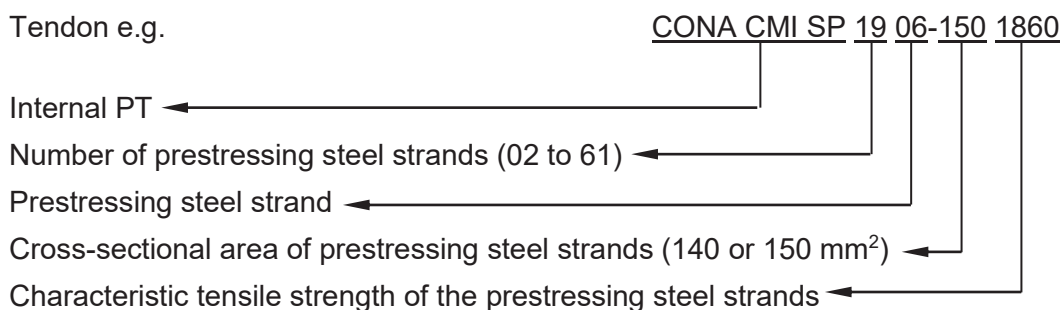

The tendons comprise 01 to 61 tensile elements, 7-wire prestressing steel strands according to Annex 30.

1.3.2 Range

1.3.2.1 General

Prestressing and overstressing forces are given in the corresponding standards and regulations in force at the place of use. The maximum prestressing and overstressing forces according to Eurocode 2 are listed in Annex 16.

The tendons consist of 01, 02, 03, 04, 05, 06, 07, 08, 09, 12, 13, 15, 16, 19, 22, 24, 25, 27, 31, 37, 42, 43, 48, 55 or 61 prestressing steel strands. By omitting prestressing steel strands in the anchorages and couplers in a radially symmetrical way, also tendons with numbers of prestressing steel strands lying between the numbers given above can be installed. Any unnecessary hole either remains undrilled or is provided with a short piece of prestressing steel strand and a wedge is inserted. For coupler anchor head K the cones of the outer pitch circle, second construction stage, may be equally redistributed if prestressing steel strands are omitted. However, the overall dimensions of the coupler anchor head K remain unchanged.

With regard to dimensions and reinforcement, anchorages and couplers with omitted prestressing steel strands remain unchanged compared to anchorages and couplers with a full number of prestressing steel strands.

1.3.2.2 CONA CMI SP n06-140

7-wire prestressing steel strand

Nominal diameter 15.3 mm

Nominal cross-sectional area 140 mm²

Maximum characteristic tensile strength 1 860 MPa

Annex 8 lists the available tendon range for CONA CMI SP n06-140.

1.3.2.3 CONA CMI SP n06-150

7-wire prestressing steel strand

Nominal diameter 15.7 mm

Nominal cross-sectional area 150 mm²

Maximum characteristic tensile strength 1 860 MPa

Annex 9 lists the available tendon range for CONA CMI SP n06-150.

1.4 Duct

1.4.1 Use of duct

For a bonded tendon a corrugated steel duct is used.

For special application, such as loop tendon and unbonded tendon, a smooth duct is used.

Alternatively, a corrugated or smooth plastic duct may be used as well, if permitted at the place of use. Minimum wall thicknesses are given in Table 3.

Table 2 Steel ducts, minimum wall thickness, t_{min}

| Number of prestressing steel strands | Wall thickness |
|--------------------------------------|----------------|
| n | t_{min} |
| — | mm |
| 02–13 | 1.5 |
| 15–25 | 2.0 |
| 27–37 | 2.5 |
| 42–61 | 3.0 |

Table 3 Plastic ducts, minimum wall thickness, t_{min}

| Number of strands | Corrugated plastic duct | | Smooth plastic duct | |
|-------------------|---------------------------|------------------------|---------------------------|------------------------|
| | Maximum degree of filling | Minimum wall thickness | Maximum degree of filling | Minimum wall thickness |
| n | f | t_{min} | f | t_{min} |
| — | — | mm | — | mm |
| 02–04 | 0.3 | 2.0 | 0.25 | 3.0 |
| 05–07 | 0.4 | 2.0 | 0.3 | 3.6 |
| 08–12 | 0.4 | 2.5 | 0.35 | 4.3 |
| 13–15 | 0.4 | 2.5 | 0.35 | 5.3 |
| 16–22 | 0.4 | 3.0 | 0.35 | 6.0 |
| 23–27 | 0.4 | 3.5 | 0.35 | 6.7 |
| 28–37 | 0.4 | 4.0 | 0.35 | 7.7 |
| 38–48 | 0.45 | 4.5 | 0.35 | 8.6 |
| 49–55 | 0.45 | 5.0 | 0.35 | 9.6 |
| 56–61 | 0.45 | 5.5 | 0.35 | 10.8 |

1.4.2 Degree of filling

The degree of filling, f , for a circular duct is generally between 0.35 and 0.50. However, the smaller values of degree of filling, 0.35 to 0.40, are used for long tendons or if the tensile elements are installed after concreting. The minimum radius of curvature can be defined with the equation given in Clause 1.9. Typical degrees of filling, f , and corresponding minimum radii of curvature, R_{\min} , are given in Annex 10, Annex 11, and Annex 12. The degree of filling is defined as

$$f = \frac{\text{cross-sectional area of prestressing steel}}{\text{cross-sectional area of inner diameter of sheath}}$$

1.4.3 Circular steel strip sheath

Steel strip sheath in conformity with EN 523², with minimum wall thicknesses according to Table 2, is used. For diameters exceeding EN 523 the requirements are met analogously. The degree of filling, f , is according to Clause 1.4.2 and the minimum radius of curvature to Clause 1.9.

Annex 11 and Annex 12 give internal duct diameters and minimum radii of curvature in which $p_{R, \max}$ has been set to 200 kN/m and 140 kN/m respectively. Smaller radii of curvature are acceptable according to the respective standards and regulations in force at the place of use.

1.4.4 Flat corrugated steel duct

For a tendon with 2, 3, 4, or 5 prestressing steel strands, a flat duct may be used, whereas EN 523 applies accordingly. Inner dimensions of the duct and the minimum radii of curvature are defined in Annex 10.

Annex 10 gives minor and major internal flat duct diameters and minimum radii of curvature, both minor and major, in which $p_{R, \max}$ has been set to 200 kN/m and 140 kN/m respectively. Smaller radii of curvature are acceptable according to the respective standards and regulations in force at the place of use.

1.4.5 Pre-bent smooth circular steel duct

If permitted at the place of use, a smooth steel duct according to EN 10255, EN 10216-1, EN 10217-1, EN 10219-1 or EN 10305-5 is used. The degree of filling, f , conforms to Clause 1.4.2 and the minimum radius of curvature to Clause 1.9. The duct is pre-bent and free of any kinks. The minimum radii of curvature, R_{\min} , is according to Clause 1.9. The minimum wall thickness of the steel duct meets the specification of Table 2.

1.5 Friction losses

For calculation of loss of prestressing force due to friction, Coulomb's law applies. Calculation of friction loss is by the equation

$$F_x = F_0 \cdot e^{-\mu \cdot (\alpha + k \cdot x)}$$

Where

F_xkNPrestressing force at a distance x along the tendon

F_0kNPrestressing force at $x = 0$ m

μ rad^{-1} Friction coefficient, see Table 4

α rad.....Sum of angular displacements over distance x , irrespective of direction or sign

k rad/m.....Wobble coefficient, see Table 4

² Standards and other documents referred to in the European Technical Assessment are listed in Annex 34 and Annex 35.

x m.....Distance along the tendon from the point where the prestressing force is equal to F_0

NOTE 1 1 rad = 1 m/m = 1

NOTE 2 As far as acceptable at the place of use, due to special measures like oiling or for a tendon layout with only few deviations the friction coefficient can be reduced by 10 to 20 %. Compared to e.g. the use of prestressing steel or sheaths with a film of rust this value increases by more than 100 %.

Table 4 Friction parameters

| Duct | Recommended values | | Range of values | |
|-------------------------|--------------------|-------|-------------------|-------------|
| | μ | k | μ | k |
| | rad ⁻¹ | rad/m | rad ⁻¹ | rad/m |
| Steel strip duct | 0.18 | 0.005 | 0.17–0.19 | 0.004–0.007 |
| Smooth steel duct | 0.18 | | 0.16–0.24 | |
| Corrugated plastic duct | 0.12 | | 0.10–0.14 | |
| Smooth plastic duct | 0.12 | | 0.10–0.14 | |

Friction loss in stressing anchorage and stressing coupler first construction stage are given in Table 5. The loss is taken into account for determination of elongation and prestressing force along the tendon. Friction in CONA CMI SP 0106 anchorage is low and does not need to be considered in design and execution.

Table 5 Friction losses in anchorages

| Tendon | Friction loss | | |
|--------------------------|---------------|---|-----|
| CONA CMI BT 0206 to 0406 | ΔF_s | % | 1.2 |
| CONA CMI BT 0506 to 0906 | | | 1.1 |
| CONA CMI BT 1206 to 3106 | | | 0.9 |
| CONA CMI BT 3706 to 6106 | | | 0.8 |

Where

ΔF_s %.....Friction loss in stressing anchorage and first construction stage of stressing coupler.

1.6 Support of tendon

Spacing of supports is between 1.0 and 1.8 m. In the region of maximum tendon curvature, a spacing of 0.8 m is applied and 0.6 m in case the minimum radius of curvature is smaller than 4.0 m. The tendons are systematically fastened in their position so that they are not displaced by placing and compacting of concrete.

1.7 Slip at anchorage and coupler

Slip at stressing and fixed anchorages and at fixed and stressing couplers, first and second construction stages, is 6 mm. Slip at moveable couplers is twice this amount. At the stressing anchorage and at the first construction stage of the stressing couplers, slip is 4 mm, provided a

prestressing jack with a wedging system and a wedging force of around 25 kN per prestressing steel strand is used.

1.8 Centre spacing and edge distance for the anchorage

In general, spacing and distances are not less than given in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26, see also Annex 13 and Annex 14.

However, a reduction of up to 15 % of the centre spacing of tendon anchorages in one direction is permitted, but should not be less than the outside diameter of the helix and placing of additional reinforcement still is possible, see Annex 27. In this case, spacing in the perpendicular direction is increased by the same percentage. The corresponding edge distance is calculated by

$$a_e = \frac{a_c}{2} - 10 \text{ mm} + c \qquad a_{\underline{e}} = \frac{a_{\underline{c}}}{2} - 10 \text{ mm} + c$$

$$b_e = \frac{b_c}{2} - 10 \text{ mm} + c \qquad b_{\underline{e}} = \frac{b_{\underline{c}}}{2} - 10 \text{ mm} + c$$

Where

$a_c, a_{\underline{c}}$ mm..... Centre spacing before and after modification

$b_c, b_{\underline{c}}$ mm..... Centre spacing in the direction perpendicular to a_c before and after modification

$a_e, a_{\underline{e}}$ mm..... Edge distance before and after modification

$b_e, b_{\underline{e}}$ mm..... Edge distance in the direction perpendicular to a_e before and after modification

c mm..... Concrete cover

Standards and regulations on concrete cover in force at the place of use are observed.

The minimum values for $a_c, b_c, a_e,$ and b_e are given in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26.

1.9 Minimum radii of curvature

The minimum radii of curvature of the tendon, R_{\min} , given in Annex 10, Annex 11, and Annex 12 correspond to

- a prestressing force of the tendon of $0.85 \cdot F_{p0.1}$ per prestressing steel strand Y1860S7
- a nominal diameter of the prestressing steel strand of $d = 15.7 \text{ mm}$
- a maximum pressure under the prestressing steel strands of $p_{R, \max} = 200 \text{ kN/m}$ and 140 kN/m
- a concrete compressive strength of $f_{cm, 0, \text{cube}} = 23 \text{ MPa}$.

In case of different tendon parameters or a different pressure under the prestressing steel strands, the calculation of the minimum radius of curvature of the tendon with circular duct can be carried out using the equation

$$R_{\min} = \frac{2 \cdot F_{pm, 0} \cdot d}{d_i \cdot p_{R, \max}}$$

Where

R_{\min} m..... Minimum radius of curvature

$F_{p0.1}$ kN..... Characteristic force at 0.1 % proof force of one single prestressing steel strand, see Annex 30

$F_{pm, 0}$ kN..... Prestressing force of the tendon

d m..... Nominal diameter of the prestressing steel strand

d_im..... Nominal inner duct diameter

$p_{R, max}$ kN/m..... Maximum pressure under the prestressing steel strands

For tendons with predominantly static loading, reduced minimum radii of curvature can be used. Recommended values for the pressure under the prestressing steel strands are

$p_{R, max} = 140\text{--}200$ kN/m for internal bonded tendons

$p_{R, max} = 800$ kN/m for smooth steel duct and predominantly static loading

In case of reduced minimum radius of curvature, the degree of filling, f , as defined in Clause 1.4.2, is between 0.25 and 0.30 to allow for proper tendon installation. Depending on the concrete strength at the time of stressing, additional reinforcement for splitting forces may be required in the areas of reduced minimum radius of curvature.

Standards and regulations on minimum radius of curvature or on the pressure under the prestressing steel strands in force at the place of use are observed.

1.10 Concrete strength at time of stressing

Concrete in conformity with EN 206 is used. At the time of stressing, the mean concrete compressive strength, $f_{cm, 0}$, is at least according to Table 6. The concrete test specimens are subjected to the same curing conditions as the structure.

For partial stressing with 30 % of the full prestressing force, the actual mean concrete compressive strength is at least $0.5 \cdot f_{cm, 0, cube}$ or $0.5 \cdot f_{cm, 0, cylinder}$. Intermediate values may be interpolated linearly according to Eurocode 2.

Helix, additional reinforcement, centre spacing and edge distance corresponding to the concrete compressive strengths are taken from Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26, see also the Clauses 1.12.7 and 2.2.3.5.

Table 6 Compressive strength of concrete

| Mean concrete strength | | $f_{cm, 0}$ | | | | | |
|--|-----|-------------|----|----|----|----|----|
| Cube strength, $f_{cm, 0, cube}$ 150 mm cube | MPa | 26 | 28 | 34 | 38 | 43 | 46 |
| Cylinder strength, $f_{cm, 0, cylinder}$ 150 mm cylinder diameter | MPa | 21 | 23 | 28 | 31 | 35 | 38 |

Where

$f_{cm, 0, cube 150}$ Mean concrete compressive strength at time of stressing, determined at cubes, 150 mm

$f_{cm, 0, cylinder \varnothing 150}$ Mean concrete compressive strength at time of stressing, determined at cylinders, diameter 150 mm

Components

1.11 Prestressing steel strands

Only 7-wire prestressing steel strands with characteristics according to Table 7 are used, see also Annex 30.

In a single tendon only prestressing steel strands spun in the same direction are used.

In the course of preparing the European Technical Assessment, no characteristic has been assessed for prestressing steel strands. In execution, a suitable prestressing steel strand that

conforms to Annex 30 and is according to the standards and regulations in force at the place of use is taken.

Table 7 Prestressing steel strands

| Maximum characteristic tensile strength ¹⁾ | f_{pk} | MPa | 1 860 | |
|---|----------|-----------------|-------|-------|
| Nominal diameter | d | mm | 15.3 | 15.7 |
| Nominal cross-sectional area | A_p | mm ² | 140 | 150 |
| Mass of prestressing steel | M | kg/m | 1.093 | 1.172 |

¹⁾ Prestressing steel strands with a characteristic tensile strength below 1 860 MPa may also be used.

1.12 Anchorage and coupler

1.12.1 General

The components of anchorage and coupler are in conformity with the specifications given in Annex 2, Annex 3, Annex 4, Annex 5, Annex 6, and Annex 7 and the technical file³. Therein the component dimensions, materials and material identification data with tolerances are given.

1.12.2 Anchor head

The anchor head, A1 to A8, is made of steel and provides regularly arranged conical holes drilled in parallel to accommodate prestressing steel strands and wedges, see Annex 2 and Annex 3. The back exits of the bore holes are provided with bell mouth openings or plastic ring cushions. In addition, threaded bores may be provided to attach a protection cap and springs A, see Annex 1 and Annex 7, and wedge retaining plate KS, see Annex 1 and Annex 7.

At the back of the anchor head there may be a step, for ease of centring the anchor head on the square plate.

1.12.3 Square plate

The square plate is a flat steel plate and are connected to the trumpet A SP, see Annex 6. In Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26 the main minimum dimensions of the square plate are listed. The square plate may be equipped with a drilled grout inlet, situated at the interface plane to the anchor head, with a connecting pipe to the trumpet.

1.12.4 Trumpet

The conical trumpet A SP, see Annex 6, and conical trumpet K, see Annex 4, is manufactured either in steel or PE, having a corrugated or plain surface. An air-vent is situated at the top of the trumpet, where a ventilation or grouting tube can be fitted.

For a larger anchorage, CONA CMI SP 3106 up to 6106, the first part of the trumpet A SP adjacent to the square plate is made of steel sheet with a thickness of 3 mm over a minimum length equal to the diameter of the trumpet.

In case the transition from trumpet to duct is made completely out of steel sheet, a 100 mm long and at least 3.5 mm thick PE-HD insert is installed at the deviating point of the prestressing steel strands on the duct side.

The conical trumpet made of PE may have either a corrugated or a plain surface. At the duct-side end there is a radius for the deviation of the prestressing steel strands and a smooth

³ The technical file of the European Technical Assessment is deposited at Österreichisches Institut für Bautechnik.

surface, to ensure a good transition to the duct. The opposite end is connected to the square plate or coupler anchor head K.

1.12.5 Coupler anchor head

The coupler anchor head K, see Annex 4, for the single plane coupler is made of steel and provides in the inner part, for anchorage of the prestressing steel strands of the first construction stage, the same arrangement of holes as the anchor head for the stressing or fixed anchorage. In the outer pitch circle there is an arrangement of holes with an inclination of 7° to accommodate the prestressing steel strands of the second construction stage. At the back of coupler anchor head K there is a step for ease of centring the coupler anchor head on the bearing trumplate. Wedge retaining plate KS, see Annex 7, and springs K, see Annex 7, with cover plate K, see Annex 4, are fastened by means of additional threaded bores.

The coupler anchor heads H1 or H2 for the sleeve coupler are made of steel and have the same basic geometry as the anchor head of the stressing or fixed anchorage, see Annex 2 and Annex 5. Compared to the anchor head of the stressing and fixed anchorage, the coupler anchor head H is higher and provide an external thread for the coupler sleeve. At the back of the coupler anchor head H1 and H2 there is a step for ease of centring the coupler anchor head on the bearing trumplate. Wedge retaining plate KS, see Annex 7, is fastened by means of additional threaded bores.

The coupler sleeve H is a steel tube, see Annex 2 and Annex 5, with an inner thread and is provided with ventilation holes.

Ring cushions, see Annex 5, are inserted in coupler anchor head H2.

1.12.6 Ring wedge

The ring wedge, see Annex 7, is in three pieces. Two different ring wedges are used.

- Ring wedge H in three pieces, fitted with spring ring
- Ring wedge F in three pieces, without spring ring or fitted with spring ring

Within one anchorage or coupler only one of these ring wedges is used.

The wedges of an inaccessible fixed anchorage are secured with either a wedge retaining plate or springs and a wedge retaining plate. An alternative is pre-locking each individual prestressing steel strand with $\sim 0.5 \cdot F_{pk}$ and applying a wedge retaining plate as per Clause 1.2.3.1. In couplers the wedges are secured with wedge retaining plate and cover plate.

1.12.7 Helix and additional reinforcement

Helix and additional reinforcement are made of ribbed reinforcing steel. The end of the helix on the anchorage side is welded to the following turn. The helix is placed in the tendon axis. Dimensions of helix and additional reinforcement conforms to the values specified in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26, see also Clause 2.2.3.5.

If required for a specific project design, the reinforcement given in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26 may be modified in accordance with the respective regulations in force at the place of use as well as with the relevant approval of the local authority and of the ETA holder to provide equivalent performance.

1.12.8 Protection cap

The protection cap is made of steel or plastic. It is provided with air vents and fastened with screws or threaded rods.

1.12.9 Material specifications

Annex 15 lists the material standards or specifications of the components.

1.13 Permanent corrosion protection

In the course of preparing the European Technical Assessment no characteristic has been assessed for components and materials of the corrosion protection system. In execution, all components and materials are selected according to the standards and regulations in force at the place of use.

Corrosion protection of the bonded tendon is provided by completely filling duct, anchorage, and coupler with grout according to EN 447, special grout according to EAD 160027-00-0301, or ready-mixed grout with an adequate composition according to standards and regulations in force at the place of use.

To protect an unbonded tendons from corrosion, ducts, couplers, and anchorages are completely filled with corrosion protection filling material as applicable at the place of use. Applicable corrosion protection filling materials are grease, wax, or an equivalent soft material. Actively circulating dry air allows for corrosion protection of a tendon as applicable at the place of use.

In case of an anchorage fully embedded in concrete, the recess is designed as to permit a reinforced concrete cover with the required dimensions and in any case with a thickness of at least 20 mm. With an exposed anchorage or with an anchorage with insufficiently thick concrete cover, the surfaces of square plate and steel cap are provided with corrosion protection.

2 Specification of the intended uses in accordance with the applicable European Assessment Document (hereinafter EAD)

2.1 Intended uses

The BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands is intended to be used for the prestressing of structures. The specific intended uses are listed in Table 8.

Table 8 Intended uses

| Line № | Use category |
|--|---|
| Use categories according to tendon configuration and material of structure | |
| 1 | Internal bonded tendon for concrete and composite structures |
| 2 | Internal unbonded tendon for concrete and composite structures |
| Optional use category | |
| 3 | Internal tendon for cryogenic applications with anchorage outside the possible cryogenic zone |

2.2 Assumptions

2.2.1 General

Concerning product packaging, transport, storage, maintenance, replacement, and repair it is the responsibility of the manufacturer to undertake the appropriate measures and to advise his clients on transport, storage, maintenance, replacement, and repair of the product as he considers necessary.

2.2.2 Packaging, transport and storage

Advice on packaging, transport, and storage includes.

- During transport of prefabricated tendons, a minimum diameter of curvature of
 - 1.65 m for tendons up to CONA CMI SP 1206,
 - 1.80 m for tendons up to CONA CMI SP 3106,
 - 2.00 m for tendons larger than CONA CMI SP 3106, of prestressing steel strand is observed.
- Temporary protection of prestressing steel and components in order to prevent corrosion during transport from production site to job site
- Transportation, storage and handling of prestressing steel and other components in a manner as to avoid damage by mechanical or chemical impact
- Protection of prestressing steel and other components from moisture
- Keeping tensile elements separate from areas where welding operations are performed

2.2.3 Design

2.2.3.1 General

It is the responsibility of the ETA holder to ensure that all necessary information on design and installation is submitted to those responsible for the design and execution of the structures executed with "BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands".

Design of the structure permits correct installation and stressing of the tendons. The reinforcement in the anchorage zone permits correct placing and compacting of concrete.

2.2.3.2 Fixed and stressing coupler

The prestressing force at the second construction stage may not be greater than that at the first construction stage, neither during construction, nor in the final state, nor due to any load combination.

2.2.3.3 Anchorage Recess

Clearance is required for handling of the prestressing jack and for stressing. The dimensions of the anchorage recess are adapted to the prestressing jack used. The ETA holder saves for reference information on the minimum dimensions of the anchorage recesses and appropriate clearance behind the anchorage.

The anchorage recess is designed with such dimensions as to ensure the required concrete cover and at least 20 mm at the protection cap in steel in the final state.

In case of exposed anchorages, concrete cover on anchorage and square plate is not required. However, the exposed surface of square plate and steel cap is provided with corrosion protection.

2.2.3.4 Maximum prestressing forces

Prestressing and overstressing forces are specified in the respective standards and regulations in force at the place of use. Annex 16 lists the maximum possible prestressing and overstressing forces according to Eurocode 2.

2.2.3.5 Centre spacing, edge distance, and reinforcement in the anchorage zone

Centre spacing, edge distance, helix, and additional reinforcement given in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26 are adopted, see Clause 1.8.

Verification of transfer of prestressing forces to structural concrete is not required if centre spacing and edge distance of anchorages and couplers as well as grade and dimensions of

additional reinforcement, see Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26, are conformed to. In the case of grouped anchorages, the additional reinforcement of the individual anchorages can be combined, provided appropriate anchorage is ensured. However, number, cross-sectional area and position with respect to the square plates remain unchanged.

The reinforcement of the structure is not employed as additional reinforcement. Reinforcement exceeding the required reinforcement of the structure may be used as additional reinforcement, provided appropriate placing is possible.

The forces outside the area of the additional reinforcement are verified and, if necessary, dealt with by appropriate reinforcement.

If required for a specific project design, the reinforcement given in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26 may be modified in accordance with the respective regulations in force at the place of use as well as with the relevant approval of the local authority and of the ETA holder to provide equivalent performance.

2.2.3.6 Tendons in masonry structures – load transfer to the structure

Post-tensioning kits are primarily used in structures made of concrete. They can, however, be used with other structural materials, e.g. in masonry structures. However, there is no particular assessment in EAD 160004-00-0301 for these applications. Hence, load transfer of stressing force from the anchorage to masonry structures is via concrete or steel members, designed according to the European Technical Assessment, especially according to the Clauses 1.8, 1.10, 1.12.7, and 2.2.3.5, or according to Eurocode 3, respectively.

The concrete or steel members have dimensions as to permit a force of $1.1 \cdot F_{pk}$ being transferred into the masonry. The verification is according to Eurocode 6 as well as to the respective standards and regulations in force at the place of use.

2.2.4 Installation

2.2.4.1 General

It is assumed that the product will be installed according to the manufacturer's instructions or – in absence of such instructions – according to the usual practice of the building professionals.

Assembly and installation of tendons is only carried out by qualified PT specialist companies with the required resources and experience in the use of multi strand internal post-tensioning systems, see CWA 14646. The respective standards and regulations in force at the place of use are considered. The company's PT site manager has a certificate, stating that she or he has been trained by the ETA holder and that she or he possesses the necessary qualifications and experience with the "BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands".

The sequence of work steps for installation of anchorage, fixed and moveable coupler is described in Annex 28 and Annex 29.

The tendons may be manufactured on site or in the factory, i.e. prefabricated tendons. The tendons are carefully handled during production, transport, storage, and installation. To avoid confusion on each site only prestressing steel strands with one nominal diameter are used.

Square plate, anchor head, and coupler anchor head are placed perpendicular to the tendon's axis, see Annex 17. Couplers are situated in a straight tendon section. At the anchorages and couplers the tendon layout provides a straight section over a length of at least 250 mm beyond the end of the trumpet. In case of tendons with a minimum or reduced radius of curvature after the trumpet, the following minimum straight lengths after the end of trumpet are recommended.

- Degree of filling $0.35 \leq f \leq 0.50$, minimum straight length = $5 \cdot d_i \geq 250$ mm
- Degree of filling $0.25 \leq f \leq 0.30$, minimum straight length = $8 \cdot d_i \geq 400$ mm

Where

f —..... Degree of filling

d_i mm..... Nominal inner diameter of duct

Before placing the concrete a final check of the installed tendon or duct is carried out.

In case of the single plane coupler K, the prestressing steel strands are provided with markers to be able to check the depth of engagement.

In the case of a moveable coupler it is ensured by means of the corresponding position and length of the coupler sheath, that in the area of the coupler sheath and corresponding trumpet area a displacement of the moveable coupler of at least $1.15 \cdot \Delta l + 30$ mm is possible without any hindrance, where Δl is the maximum expected displacement of the coupler at stressing.

2.2.4.2 Stressing operation

With a mean concrete compressive strength in the anchorage zone according to the values laid down in Annex 18, Annex 19, Annex 20, Annex 21, Annex 22, Annex 23, Annex 24, Annex 25, and Annex 26 full prestressing may be applied.

Stressing and, if applicable, wedging is carried out using a suitable prestressing jack. The wedging force corresponds to approximately 25 kN per wedge.

Elongation and prestressing forces are continuously checked during the stressing operation. The results of the stressing operation are recorded and the measured elongations compared with the prior calculated values.

After releasing the prestressing force from the prestressing jack, the tendon is pulled in and reduces the elongation by the amount of slip at the anchor head of the stressing anchorage.

Information on the prestressing equipment has been submitted to Österreichisches Institut für Bautechnik. The ETA holder keeps available information on prestressing jacks and appropriate clearance behind the anchorage.

The safety-at-work and health protection regulations shall be complied with.

2.2.4.3 Restressing

Restressing of tendons in combination with release and reuse of wedges is permitted, whereas the wedges bite into a least 15 mm of virgin strand surface and no wedge bite remains inside the final length of the tendon between anchorages.

Tendons with 7-wire prestressing steel strands that remain restressable throughout the working life of the structure. Grease, wax, or an equivalent soft material is used as filling material or circulating dry air is used as corrosion protection. Moreover, a strand protrusion at the stressing anchor remains with a length compatible with the prestressing jack used.

2.2.4.4 Exchanging tendons

Exchange of unbonded tendons is permitted, subject of acceptance at the pace of use. The specifications for exchangeable tendons are defined during the design phase.

For exchangeable tendons, wax or grease is used as filling material or circulating dry air is used as corrosion protection. Moreover, a strand protrusion remains at the stressing anchor with a length allowing safe release of the complete prestressing force.

Stressing and fixed anchorages are accessible and adequate space is provided behind the anchorages.

2.2.4.5 Filling operations

2.2.4.5.1 Grouting

Grout is injected through the inlet holes until it escapes from the outlet tubes with the same consistency. To avoid voids in the hardened grout special measures are applied for long tendons, tendon paths with distinct high points, or inclined tendons. All vents, grouting inlets,

and protection caps are sealed immediately after grouting. In case of couplers K, the second stage holes, wedges and springs are checked for cleanness before and immediately after grouting the first construction stage.

The standards observed for cement grouting in prestressing ducts are EN 445, EN 446, and EN 447 or the standards and regulations in force at the place of use are applied for ready mixed grout.

2.2.4.5.2 Filling with grease, wax, and an equivalent soft material

The recommendations of the supplier are relevant for the filling material applied. The filling process with grease, wax, and an equivalent soft material follows a similar procedure as the one specified for grouting. However, a different filling procedure might be possible if permitted at the place of use.

2.2.4.5.3 Circulating dry air

Actively circulating dry air allows for corrosion protection of tendons, provided a permanent monitoring of the drying and circulation system is in place. This is in general only applicable to structures of particular importance. The respective standards and regulations in force at the place of use are observed.

2.2.4.5.4 Filling records

The results of the grouting and filling operation are recorded in detail in filling records.

2.2.4.6 Welding

Ducts may be welded.

The helix may be welded to the square plate to secure its position.

After installation of the prestressing steel strands further welding operations may not be carried out on the tendons. In case of welding operations near tendons, precautionary measures are required to avoid damage to the corrosion protection system. However, plastic components may be welded even after installation of the tendons.

2.3 Assumed working life

The European Technical Assessment is based on an assumed working life of the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands of 100 years, provided that the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands is subject to appropriate installation, use, and maintenance, see Clause 2.2. These provisions are based upon the current state of the art and the available knowledge and experience.

In normal use conditions, the real working life may be considerably longer without major degradation affecting the basic requirements for construction works⁴.

The indications given as to the working life of the construction product cannot be interpreted as a guarantee, neither given by the product manufacturer or his representative nor by EOTA nor by the Technical Assessment Body, but are regarded only as a means for expressing the expected economically reasonable working life of the product.

⁴ The real working life of a product incorporated in a specific works depends on the environmental conditions to which that works are subject, as well as on the particular conditions of design, execution, use, and maintenance of that works. Therefore, it cannot be excluded that in certain cases the real working life of the product may also be shorter than the assumed working life.

3 Performance of the product and references to the methods used for its assessment

3.1 Essential characteristics

The performances of the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands for the essential characteristics are given in Table 9 and Table 10. In Annex 33 the combinations of essential characteristics and corresponding intended uses are listed.

Table 9 Essential characteristics and performances of the product

| No | Essential characteristic | Product performance |
|---|---|---------------------|
| Product BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands | | |
| Intended use The PT system is intended to be used for the prestressing of structures, Clause 2.1, Table 8, lines No 1 and 2. | | |
| Basic requirement for construction works 1: Mechanical resistance and stability | | |
| 1 | Resistance to static load | See Clause 3.2.1.1. |
| 2 | Resistance to fatigue | See Clause 3.2.1.2. |
| 3 | Load transfer to the structure | See Clause 3.2.1.3. |
| 4 | Friction coefficient | See Clause 3.2.1.4. |
| 5 | Deviation, deflection (limits) for internal bonded and internal unbonded tendon | See Clause 3.2.1.5. |
| 6 | Assessment of assembly | See Clause 3.2.1.6. |
| 7 | Corrosion protection | See Clause 3.2.1.7. |
| Basic requirement for construction works 2: Safety in case of fire | | |
| 8 | Reaction to fire | See Clause 3.2.2.1. |
| Basic requirement for construction works 3: Hygiene, health and the environment | | |
| 9 | Content, emission and/or release of dangerous substances | See Clause 3.2.3.1. |
| Basic requirement for construction works 4: Safety and accessibility in use | | |
| — | Not relevant. No characteristic assessed. | — |
| Basic requirement for construction works 5: Protection against noise | | |
| — | Not relevant. No characteristic assessed. | — |
| Basic requirement for construction works 6: Energy economy and heat retention | | |
| — | Not relevant. No characteristic assessed. | — |
| Basic requirement for construction works 7: Sustainable use of natural resources | | |
| — | No characteristic assessed. | — |

Table 10 Essential characteristics and performances of the product in addition to Table 9 for an optional use category

| № | Additional essential characteristic | Product performance |
|---|---|---------------------|
| Product BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands Optional use category The PT system is intended to be used for the prestressing of structures, Clause 2.1, Table 8, line № 3, Internal tendon for cryogenic applications with anchorage outside the possible cryogenic zone | | |
| Basic requirement for construction works 1: Mechanical resistance and stability | | |
| 10 | Resistance to static load under cryogenic conditions for applications with anchorage/coupling outside the possible cryogenic zone | See Clause 3.2.4.1. |

3.2 Product performance

3.2.1 Mechanical resistance and stability

3.2.1.1 Resistance to static load

The PT system as described in the ETA meets the acceptance criteria of EAD 160004-00-0301, Clause 2.2.1. The characteristic values of maximum force, F_{pk} , of the tendon for prestressing steel strands according to Annex 30 are listed in Annex 8 and Annex 9.

3.2.1.2 Resistance to fatigue

The PT system as described in the ETA meets the acceptance criteria of EAD 160004-00-0301, Clause 2.2.2. The characteristic values of maximum force, F_{pk} , of the tendon for prestressing steel strands according to Annex 30 are listed in Annex 8 and Annex 9.

3.2.1.3 Load transfer to the structure

The PT system as described in the ETA meets the acceptance criteria of EAD 160004-00-0301, Clause 2.2.3. The characteristic values of maximum force, F_{pk} , of the tendon for prestressing steel strands according Annex 30 are listed in Annex 8 and Annex 9.

3.2.1.4 Friction coefficient

For friction losses including friction coefficient see Clause 1.5.

3.2.1.5 Deviation, deflection (limits) for internal bonded and internal unbonded tendon

For minimum radii of curvature see Clause 1.9.

3.2.1.6 Assessment of assembly

The PT system as described in the ETA meets the acceptance criteria of EAD 160004-00-0301, Clause 2.2.7.

3.2.1.7 Corrosion protection

The PT system as described in the ETA meets the acceptance criteria of EAD 160004-00-0301, Clause 2.2.13.

3.2.2 Safety in case of fire

3.2.2.1 Reaction to fire

The performance of components made of steel or cast iron is Class A1 without testing.

The performance of components of other materials has not been assessed.

3.2.3 Hygiene, health and the environment

3.2.3.1 Content, emission and/or release of dangerous substances

According to the manufacturer's declaration, the PT system does not contain dangerous substances.

- SVOC and VOC

The performance of components made of steel or cast iron that are free of coating with organic material is no emission of SVOC and VOC.

The performance of components of other materials has not been assessed.

- Leachable substances

The product is not intended to be in direct contact to soil, ground water, and surface water.

3.2.4 Mechanical resistance and stability

3.2.4.1 Resistance to static load under cryogenic conditions for applications with anchorage/coupling outside the possible cryogenic zone

The PT system as described in the ETA meets the acceptance criteria of EAD 160004-00-0301, Clause 2.2.8. The characteristic values of maximum force, F_{pk} , of the tendon for prestressing steel strands according to Annex 30 are listed in Annex 8 and Annex 9.

3.3 Assessment methods

The assessment of the essential characteristics in Clause 3.1 of the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands for the intended uses and in relation to the requirements for mechanical resistance and stability, safety in case of fire, and for hygiene, health and the environment in the sense of the basic requirements for construction works № 1, 2, and 3 of Regulation (EU) № 305/2011 has been made in accordance with Annex A of EAD 160004-00-0301, Post-tensioning kits for prestressing of structures, for

- Item 1, Internal bonded tendon
- Item 2, Internal unbonded tendon
- Item 8, Optional Use Category. Internal tendon – Cryogenic applications with anchorage/coupling outside the possible cryogenic zone

3.4 Identification

The European Technical Assessment for the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands is issued on the basis of agreed data⁵ that identify the assessed product. Changes to materials, to composition, or to characteristics of the product, or to the production process could result in these deposited data being incorrect. Österreichisches Institut für Bautechnik should be notified before the changes are introduced, as an amendment of the European Technical Assessment is possibly necessary.

⁵ The technical file of the European Technical Assessment is deposited at Österreichisches Institut für Bautechnik.

4 Assessment and verification of constancy of performance (hereinafter AVCP) system applied, with reference to its legal base

4.1 System of assessment and verification of constancy of performance

According to Commission Decision 98/456/EC the system of assessment and verification of constancy of performance to be applied to the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands is System 1+. System 1+ is detailed in Commission Delegated Regulation (EU) № 568/2014 of 18 February 2014, Annex, point 1.1., and provides for the following items.

- (a) The manufacturer shall carry out
 - (i) factory production control;
 - (ii) further testing of samples taken at the manufacturing plant by the manufacturer in accordance with the prescribed test plan⁶.
- (b) The notified product certification body shall decide on the issuing, restriction, suspension, or withdrawal of the certificate of constancy of performance of the construction product on the basis of the outcome of the following assessments and verifications carried out by that body
 - (i) an assessment of the performance of the construction product carried out on the basis of testing (including sampling), calculation, tabulated values, or descriptive documentation of the product;
 - (ii) initial inspection of the manufacturing plant and of factory production control;
 - (iii) continuing surveillance, assessment, and evaluation of factory production control;
 - (iv) audit-testing of samples taken by the notified product certification body at the manufacturing plant or at the manufacturer's storage facilities.

4.2 AVCP for construction products for which a European Technical Assessment has been issued

Notified bodies undertaking tasks under System 1+ shall consider the European Technical Assessment issued for the construction product in question as the assessment of the performance of that product. Notified bodies shall therefore not undertake the tasks referred to in Clause 4.1, point (b) (i).

5 Technical details necessary for the implementation of the AVCP system, as provided for in the applicable EAD

5.1 Tasks for the manufacturer

5.1.1 Factory production control

The kit manufacturer exercises permanent internal control of the production. All the elements, procedures, and specifications adopted by the kit manufacturer are documented in a systematic manner in the form of written policies and procedures.

- Control of the incoming materials

The manufacturer checks the incoming materials to establish conformity with their specifications.

- Inspection and testing

Kind and frequency of inspections, tests, and checks, conducted during production and on the final product normally include.

⁶ The prescribed test plan has been deposited with Österreichisches Institut für Bautechnik and is handed over only to the notified product certification body involved in the procedure for the assessment and verification of constancy of performance. The prescribed test plan is also referred to as control plan.

- Definition of the number of samples taken by the kit manufacturer
- Material properties e.g. tensile strength, hardness, surface finish, chemical composition, etc.
- Determination of the dimensions of components
- Check correct assembly
- Documentation of tests and test results

All tests are performed according to written procedures with suitable calibrated measuring devices. All results of inspections, tests, and checks are recorded in a consistent and systematic way. The basic elements of the prescribed test plan are given in Annex 31, conform to EAD 160004-00-0301, Table 3, and are specified in the quality management plan of the BBR VT CONA CMI SP – Internal Post-tensioning System with 01 to 61 Strands.

The results of inspections, tests, and checks are evaluated for conformity. Shortcomings request the manufacturer to immediately implement measures to eliminate the defects.

- Control of non-conforming products

Products, which are considered as not conforming to the prescribed test plan, are immediately marked and separated from such products that do conform. Factory production control addresses control of non-conforming products.

- Complaints

Factory production control includes procedures to keep records of all complaints about the PT system.

The records are presented to the notified product certification body involved in continuous surveillance and are kept at least for ten years after the product has been placed on the market. On request, the records are presented to Österreichisches Institut für Bautechnik.

At least once a year the manufacturer audits the manufacturers of the components given in Annex 32.

5.1.2 Declaration of performance

The manufacturer is responsible for preparing the declaration of performance. When all the criteria of the assessment and verification of constancy of performance are met, including the certificate of constancy of performance issued by the notified product certification body, the manufacturer draws up the declaration of performance. Essential characteristics to be included in the declaration of performance for the corresponding intended use are given in Table 9 and Table 10. In Annex 33 the combinations of essential characteristics and corresponding intended uses are listed.

5.2 Tasks for the notified product certification body

5.2.1 Initial inspection of the manufacturing plant and of factory production control


The notified product certification body establishes that, in accordance with the prescribed test plan, the manufacturing plant, in particular personnel and equipment, and the factory production control are suitable to ensure a continuous manufacturing of the PT system according to the given technical specifications. For the most important activities, EAD 160004-00-0301, Table 4 summarises the minimum procedure.

5.2.2 Continuing surveillance, assessment and evaluation of factory production control


The activities are conducted by the notified product certification body and include surveillance inspections. The kit manufacturer is inspected at least once a year. Factory production control is inspected and samples are taken for independent single tensile element tests.

Anchorage CONA CMI SP 0106


Anchor head A3

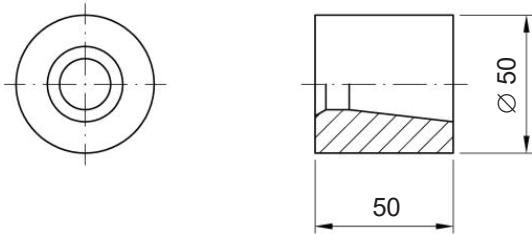


Anchor head A7

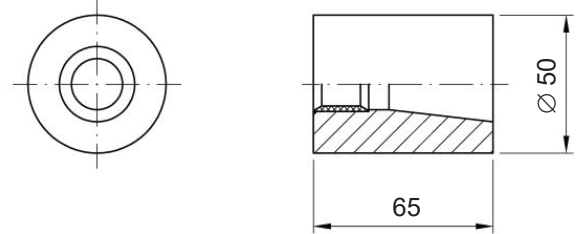


Coupler anchor head H1

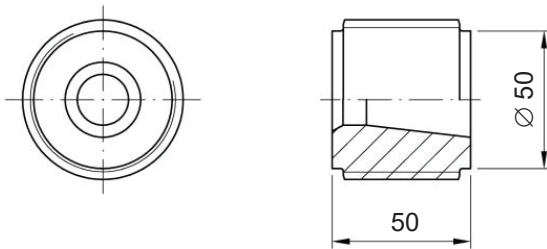

Coupler anchor head H2

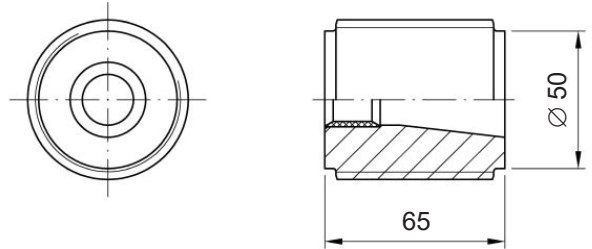

Coupler sleeve H

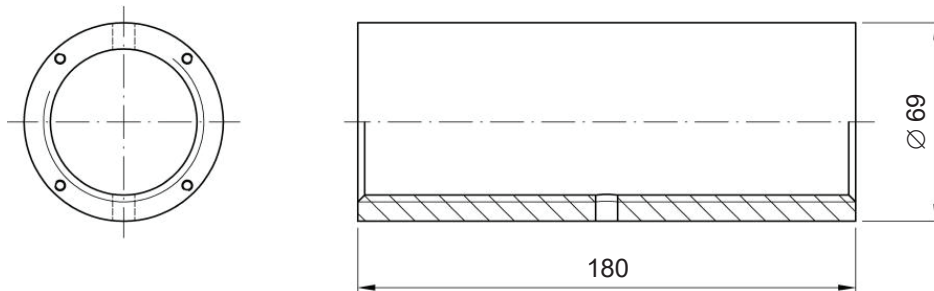

Dimensions in mm



Internal Post-tensioning System
 Anchorage and coupler CONA CMI SP 0106

Annex 2
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy


Anchor head A1-A4




Anchor head A5-A8




Ring cushion
Anchor head A5-A8



Cone
A1-A4



Cone
A5-A8



Dimensions in mm

| | | | | | | | | | | | | | | |
|----------------------------------|-------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|----|
| Number of strands | | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 12 | 13 | 15 | 16 | |
| Anchor head | | | | | | | | | | | | | | |
| Nominal diameter \varnothing_A | mm | 90 | 100 | 100 | 130 | 130 | 130 | 150 | 160 | 160 | 180 | 200 | 200 | |
| Height head A1-A4 | H_A | mm | 50 | 50 | 50 | 50 | 55 | 55 | 60 | 60 | 65 | 72 | 75 | 80 |
| Height head A5-A8 | | mm | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 70 | 72 | 75 | 80 |


| | | | | | | | | | | | | | |
|----------------------------------|-------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of strands | | 19 | 22 | 24 | 25 | 27 | 31 | 37 | 42 | 43 | 48 | 55 | 61 |
| Anchor head | | | | | | | | | | | | | |
| Nominal diameter \varnothing_A | mm | 200 | 225 | 240 | 255 | 255 | 255 | 285 | 300 | 320 | 325 | 335 | 365 |
| Height head A1-A4 | H_A | mm | 85 | 95 | 100 | 100 | 105 | 110 | — | — | — | — | — |
| Height head A5-A8 | | mm | 85 | 95 | 100 | 100 | 105 | 110 | 120 | 130 | 130 | 140 | 150 |




Internal Post-tensioning System
Anchor heads

Annex 3
of European Technical Assessment
ETA-09/0287 of 19.09.2018


Cover plate K

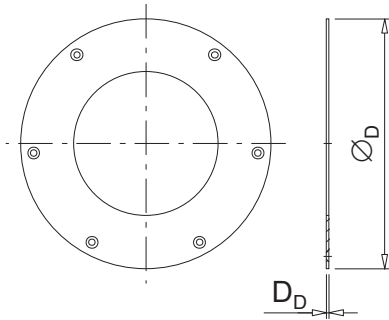

Coupler head K

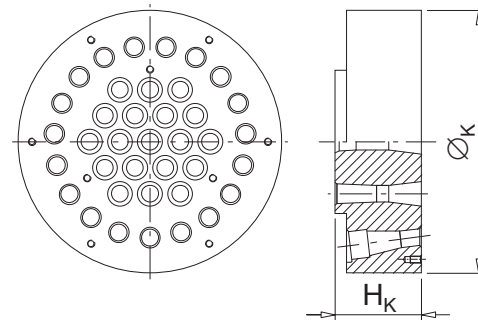

Trumpet K

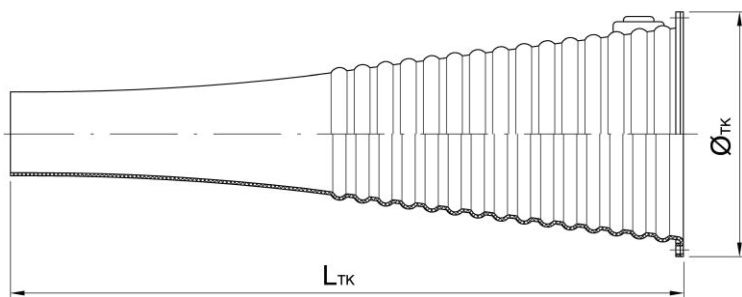

| Number of strands | | | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 12 |
|-----------------------|-----------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Coupler head K | | | | | | | | | | | |
| Diameter | Ø _K | mm | 195 | 195 | 195 | 210 | 210 | 210 | 250 | 250 | 250 |
| Height | H _K | mm | 85 | 85 | 85 | 85 | 85 | 85 | 90 | 90 | 90 |
| Cover plate | | | | | | | | | | | |
| Diameter | Ø _D | mm | 192 | 192 | 192 | 207 | 207 | 207 | 246 | 246 | 246 |
| Thickness | D _D | mm | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 | 3 |
| Trumpet K | | | | | | | | | | | |
| Diameter | Ø _{TK} | mm | 185 | 185 | 185 | 203 | 203 | 203 | 240 | 240 | 240 |
| Length | L _{TK} | mm | 470 | 470 | 470 | 640 | 640 | 640 | 845 | 845 | 730 |



| Number of strands | | | 13 | 15 | 16 | 19 | 22 | 24 | 25 | 27 | 31 |
|-----------------------|-----------------|----|-----|-----|-----|-----|-----|-------|-------|-------|-------|
| Coupler head K | | | | | | | | | | | |
| Diameter | Ø _K | mm | 290 | 290 | 290 | 290 | 310 | 340 | 390 | 390 | 390 |
| Height | H _K | mm | 90 | 90 | 95 | 95 | 105 | 120 | 125 | 125 | 130 |
| Cover plate | | | | | | | | | | | |
| Diameter | Ø _D | mm | 286 | 286 | 286 | 286 | 306 | 336 | 386 | 386 | 386 |
| Thickness | D _D | mm | 3 | 3 | 3 | 3 | 5 | 5 | 5 | 5 | 5 |
| Trumpet K | | | | | | | | | | | |
| Diameter | Ø _{TK} | mm | 275 | 275 | 275 | 275 | 305 | 330 | 375 | 375 | 375 |
| Length | L _{TK} | mm | 890 | 890 | 890 | 775 | 840 | 1 090 | 1 265 | 1 265 | 1 150 |





Internal Post-tensioning System
 Coupler K and trumpet K

Annex 4
 of European Technical Assessment
ETA-09/0287 of 19.09.2018


Coupler head H1

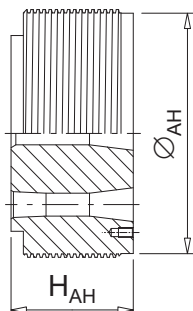



Coupler head H2

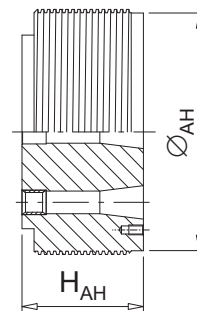

Ring cushion
 Coupler head H2



Coupler sleeve H

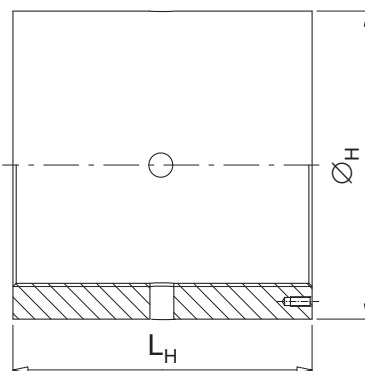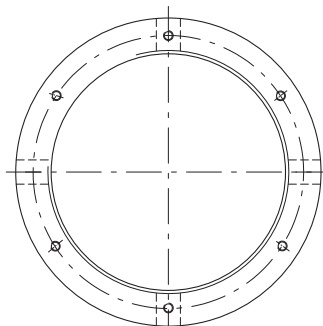

Dimensions in mm

| Number of strands | | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 12 | 13 | 15 | 16 |
|---------------------------------------|----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Coupler anchor heads H1 and H2 | | | | | | | | | | | | | |
| Nominal diameter \varnothing_{AH} | mm | 90 | 95 | 100 | 130 | 130 | 130 | 150 | 160 | 160 | 180 | 200 | 200 |
| Height head H1 | H_{AH} | mm | 50 | 50 | 55 | 55 | 60 | 65 | 65 | 70 | 80 | 80 | 80 |
| Height head H2 | | mm | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 70 | 80 | 80 | 80 |
| Coupler sleeve H | | | | | | | | | | | | | |
| Minimum diameter \varnothing_H | mm | 114 | 124 | 133 | 163 | 167 | 170 | 192 | 203 | 213 | 233 | 259 | 259 |
| Length sleeve | L_H | mm | 180 | 180 | 180 | 180 | 190 | 200 | 200 | 210 | 230 | 230 | 240 |


| Number of strands | | 19 | 22 | 24 | 25 | 27 | 31 | 37 | 42 | 43 | 48 | 55 | 61 |
|---------------------------------------|----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Coupler anchor heads H1 and H2 | | | | | | | | | | | | | |
| Nominal diameter \varnothing_{AH} | mm | 200 | 225 | 240 | 255 | 255 | 255 | 285 | 300 | 320 | 325 | 335 | 365 |
| Height head H1 | H_{AH} | mm | 95 | 100 | 100 | 100 | 105 | 115 | — | — | — | — | — |
| Height head H2 | | mm | 95 | 100 | 100 | 100 | 105 | 115 | 125 | 135 | 135 | 145 | 160 |
| Coupler sleeve H | | | | | | | | | | | | | |
| Minimum diameter \varnothing_H | mm | 269 | 296 | 312 | 327 | 330 | 338 | 373 | 395 | 413 | 425 | 443 | 475 |
| Length sleeve | L_H | mm | 270 | 270 | 280 | 280 | 300 | 320 | 340 | 360 | 360 | 380 | 410 |



Internal Post-tensioning System
 Coupler H


Annex 5
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

Square plate

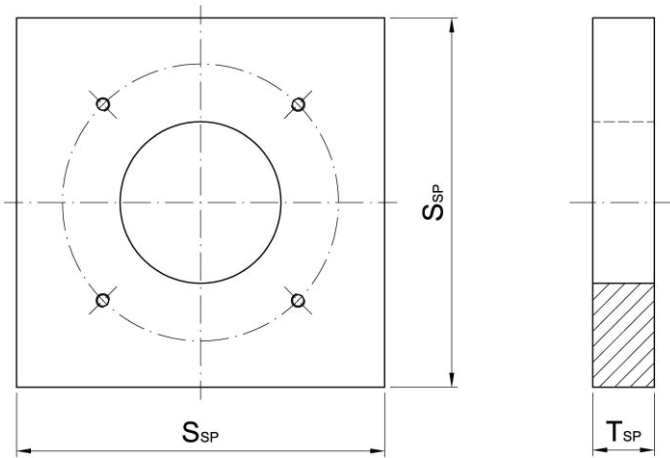


Minimum dimensions see Annexes 18 to 26.

Trumpet A SP 0206 – 2406

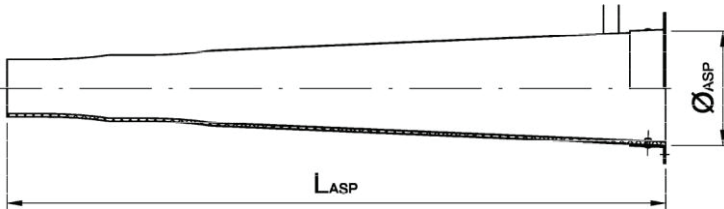

Trumpet A SP 2506 – 6106

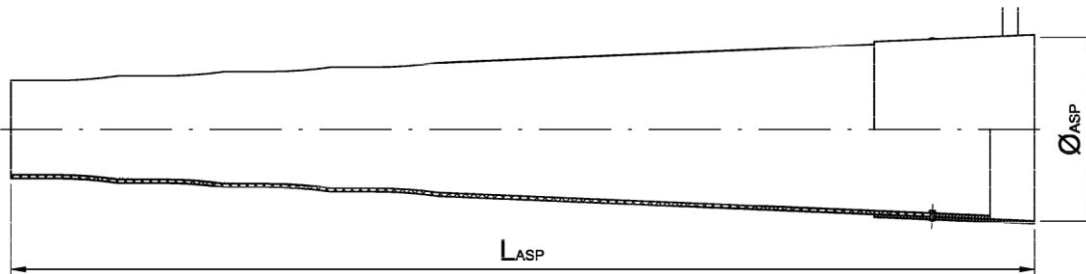

| Number of strands | | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 12 | 13 | 15 | 16 |
|---------------------|---------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Trumpet A SP | | | | | | | | | | | | | |
| Diameter | Ø _{ASP} mm | 70 | 70 | 70 | 90 | 90 | 90 | 112 | 127 | 127 | 142 | 160 | 160 |
| Length | L _{ASP} mm | 421 | 421 | 421 | 401 | 401 | 401 | 655 | 739 | 739 | 794 | 894 | 894 |





| Number of strands | | 19 | 22 | 24 | 25 | 27 | 31 | 37 | 42 | 43 | 48 | 55 | 61 |
|---------------------|---------------------|-----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| Trumpet A SP | | | | | | | | | | | | | |
| Diameter | Ø _{ASP} mm | 160 | 180 | 195 | 210 | 210 | 210 | 230 | 245 | 270 | 270 | 270 | 305 |
| Length | L _{ASP} mm | 894 | 1 017 | 1 196 | 1 150 | 1 150 | 1 150 | 1 270 | 1 315 | 1 506 | 1 506 | 1 506 | 1 684 |




Internal Post-tensioning System
 Square plate and trumpet A SP

Annex 6
 of European Technical Assessment
ETA-09/0287 of 19.09.2018


Wedges




Tension ring




Wedge retaining plate KS



Spring A



Spring K



Dimensions in mm

| | | | | | | | | | | | | | | |
|---------------------------------|--------------------|----|----|----|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of strands | | 02 | 03 | 04 | 05 | 06 | 07 | 08 | 09 | 12 | 13 | 15 | 16 | |
| Wedge retaining plate KS | | | | | | | | | | | | | | |
| Diameter | \varnothing_{KS} | mm | 65 | 73 | 91 | 117 | 117 | 117 | 130 | 157 | 157 | 145 | 185 | 185 |
| Thickness | D_{KS} | mm | 5 | 5 | 5 | 5 | 5 | 5 | 8 | 8 | 8 | 10 | 10 | 10 |

| | | | | | | | | | | | | | | |
|---------------------------------|--------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of strands | | 19 | 22 | 19 | 22 | 24 | 25 | 27 | 31 | 37 | 42 | 43 | 48 | |
| Wedge retaining plate KS | | | | | | | | | | | | | | |
| Diameter | \varnothing_{KS} | mm | 185 | 205 | 232 | 234 | 234 | 234 | 240 | 275 | 275 | 275 | 310 | 310 |
| Thickness | D_{KS} | mm | 10 | 10 | 10 | 10 | 10 | 10 | 12 | 12 | 12 | 12 | 12 | 12 |



Internal Post-tensioning System
 Wedges and accessories

Annex 7
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

CONA CMI SP n06-150

| Number of strands | Nominal cross-sectional area of prestressing steel | Nominal mass of prestressing steel | Characteristic value of maximum force of tendon | |
|-------------------|--|------------------------------------|---|------------------------------|
| | | | $f_{pk} = 1\,770\text{ MPa}$ | $f_{pk} = 1\,860\text{ MPa}$ |
| n | A_p | M | F_{pk} | F_{pk} |
| — | mm ² | kg/m | kN | kN |
| 01 | 150 | 1.2 | 266 | 279 |
| 02 | 300 | 2.3 | 532 | 558 |
| 03 | 450 | 3.5 | 798 | 837 |
| 04 | 600 | 4.7 | 1 064 | 1 116 |
| 05 | 750 | 5.9 | 1 330 | 1 395 |
| 06 | 900 | 7.0 | 1 596 | 1 674 |
| 07 | 1 050 | 8.2 | 1 862 | 1 953 |
| 08 | 1 200 | 9.4 | 2 128 | 2 232 |
| 09 | 1 350 | 10.5 | 2 394 | 2 511 |
| 12 | 1 800 | 14.1 | 3 192 | 3 348 |
| 13 | 1 950 | 15.2 | 3 458 | 3 627 |
| 15 | 2 250 | 17.6 | 3 990 | 4 185 |
| 16 | 2 400 | 18.8 | 4 256 | 4 464 |
| 19 | 2 850 | 22.3 | 5 054 | 5 301 |
| 22 | 3 300 | 25.8 | 5 852 | 6 138 |
| 24 | 3 600 | 28.1 | 6 384 | 6 696 |
| 25 | 3 750 | 29.3 | 6 650 | 6 975 |
| 27 | 4 050 | 31.6 | 7 182 | 7 533 |
| 31 | 4 650 | 36.3 | 8 246 | 8 649 |
| 37 | 5 550 | 43.4 | 9 842 | 10 323 |
| 42 | 6 300 | 49.2 | 11 172 | 11 718 |
| 43 | 6 450 | 50.4 | 11 438 | 11 997 |
| 48 | 7 200 | 56.3 | 12 768 | 13 392 |
| 55 | 8 250 | 64.5 | 14 630 | 15 345 |
| 61 | 9 150 | 71.5 | 16 226 | 17 019 |




CONA CMI SP

Internal Post-tensioning System
 Tendon ranges for CONA CMI SP n06-150

Annex 9
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy

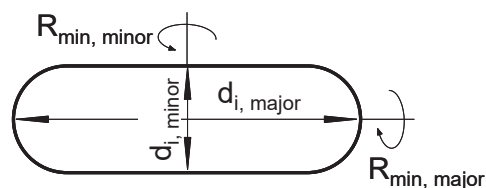

**Inner dimensions, d_i , of flat duct and minimum radius of curvature, R_{min} ,
 for $p_{R, \text{max}} = 200 \text{ kN/m}$**

| Number of strands | Inner dimensions | | Radius of curvature | |
|-------------------|-----------------------|-----------------------|-------------------------|-------------------------|
| | $d_{i, \text{major}}$ | $d_{i, \text{minor}}$ | $R_{\text{min, major}}$ | $R_{\text{min, minor}}$ |
| — | mm | mm | m | m |
| 02 | 40 | 20 | 2.0 | 2.1 |
| 03 | 55 | 20 | 2.0 | 3.1 |
| 04 | 70 | 20 | 2.0 | 4.2 |
| 05 | 85 | 20 | 2.0 | 5.2 |

**Inner dimensions, d_i , of flat duct and minimum radius of curvature, R_{min} ,
 for $p_{R, \text{max}} = 140 \text{ kN/m}$**

| Number of strands | Inner dimensions | | Radius of curvature | |
|-------------------|-----------------------|-----------------------|-------------------------|-------------------------|
| | $d_{i, \text{major}}$ | $d_{i, \text{minor}}$ | $R_{\text{min, major}}$ | $R_{\text{min, minor}}$ |
| — | mm | mm | m | m |
| 02 | 40 | 20 | 2.0 | 3.0 |
| 03 | 55 | 20 | 2.0 | 4.5 |
| 04 | 70 | 20 | 2.0 | 6.0 |
| 05 | 85 | 20 | 2.0 | 7.5 |

Inner diameter of circular duct, d_i , and minimum radius of curvature, R_{min} , for $p_{R, max} = 200$ kN/m

| Number of strands n | $f \approx 0.35$ | | $f \approx 0.40$ | | $f \approx 0.45$ | | $f \approx 0.50$ | |
|------------------------|------------------|----------------|------------------|----------------|------------------|----------------|------------------|----------------|
| | d_i mm | R_{min} m | d_i mm | R_{min} m | d_i mm | R_{min} m | d_i mm | R_{min} m |
| 01 | 35 | 2.0 | — | — | — | — | — | — |
| 02 | 35 | 2.0 | — | — | — | — | — | — |
| 03 | 40 | 2.5 | — | — | — | — | — | — |
| 04 | 45 | 2.9 | 45 | 2.9 | — | — | — | — |
| 05 | 50 | 3.3 | 50 | 3.3 | — | — | — | — |
| 06 | 55 | 3.6 | 55 | 3.6 | — | — | — | — |
| 07 | 60 | 3.8 | 60 | 3.8 | — | — | — | — |
| 08 | 65 | 4.0 | 60 | 4.4 | 60 | 4.4 | — | — |
| 09 | 70 | 4.2 | 65 | 4.5 | 60 | 4.9 | 60 | 4.9 |
| 12 | 80 | 4.9 | 75 | 5.3 | 70 | 5.6 | 70 | 5.6 |
| 13 | 85 | 5.0 | 80 | 5.3 | 75 | 5.7 | 70 | 6.1 |
| 15 | 90 | 5.5 | 85 | 5.8 | 80 | 6.2 | 75 | 6.6 |
| 16 | 95 | 5.5 | 85 | 6.2 | 80 | 6.6 | 80 | 6.6 |
| 19 | 100 | 6.2 | 95 | 6.6 | 90 | 6.9 | 85 | 7.3 |
| 22 | 110 | 6.6 | 100 | 7.2 | 95 | 7.6 | 90 | 8.0 |
| 24 | 115 | 6.9 | 105 | 7.5 | 100 | 7.9 | 95 | 8.3 |
| 25 | 115 | 7.1 | 110 | 7.5 | 105 | 7.8 | 100 | 8.2 |
| 27 | 120 | 7.4 | 115 | 7.7 | 105 | 8.4 | 100 | 8.9 |
| 31 | 130 | 7.8 | 120 | 8.5 | 115 | 8.8 | 110 | 9.3 |
| 37 | 140 | 8.7 | 135 | 9.0 | 125 | 9.7 | 120 | 10.1 |
| 42 | 150 | 9.2 | 140 | 9.8 | 135 | 10.2 | 125 | 11.0 |
| 43 | 155 | 9.1 | 145 | 9.7 | 135 | 10.5 | 130 | 11.0 |
| 48 | 160 | 9.8 | 150 | 10.5 | 145 | 10.9 | 135 | 11.7 |
| 55 | 175 | 10.3 | 160 | 11.3 | 155 | 11.6 | 145 | 12.5 |
| 61 | 180 | 11.1 | 170 | 11.8 | 160 | 12.5 | 155 | 12.9 |



Internal Post-tensioning System
 Minimum radius of curvature of circular duct for
 $p_{R, max} = 200$ kN/m

Annex 11
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

Inner diameter of circular duct, d_i , and minimum radius of curvature, R_{min} , for $p_{R, max} = 140$ kN/m

| Number of strands n | $f \approx 0.35$ | | $f \approx 0.40$ | | $f \approx 0.45$ | | $f \approx 0.50$ | |
|------------------------|------------------|----------------|------------------|----------------|------------------|----------------|------------------|----------------|
| | d_i mm | R_{min} m | d_i mm | R_{min} m | d_i mm | R_{min} m | d_i mm | R_{min} m |
| 01 | 35 | 2.0 | — | — | — | — | — | — |
| 02 | 35 | 2.7 | — | — | — | — | — | — |
| 03 | 40 | 3.5 | — | — | — | — | — | — |
| 04 | 45 | 4.2 | 45 | 4.2 | — | — | — | — |
| 05 | 50 | 4.7 | 50 | 4.7 | — | — | — | — |
| 06 | 55 | 5.1 | 55 | 5.1 | — | — | — | — |
| 07 | 60 | 5.5 | 60 | 5.5 | — | — | — | — |
| 08 | 65 | 5.8 | 60 | 6.3 | 60 | 6.3 | — | — |
| 09 | 70 | 6.0 | 65 | 6.5 | 60 | 7.0 | 60 | 7.0 |
| 12 | 80 | 7.0 | 75 | 7.5 | 70 | 8.0 | 70 | 8.0 |
| 13 | 85 | 7.2 | 80 | 7.6 | 75 | 8.1 | 70 | 8.7 |
| 15 | 90 | 7.8 | 85 | 8.3 | 80 | 8.8 | 75 | 9.4 |
| 16 | 95 | 7.9 | 85 | 8.8 | 80 | 9.4 | 80 | 9.4 |
| 19 | 100 | 8.9 | 95 | 9.4 | 90 | 9.9 | 85 | 10.5 |
| 22 | 110 | 9.4 | 100 | 10.3 | 95 | 10.9 | 90 | 11.5 |
| 24 | 115 | 9.8 | 105 | 10.7 | 100 | 11.3 | 95 | 11.8 |
| 25 | 115 | 10.2 | 110 | 10.7 | 105 | 11.2 | 100 | 11.7 |
| 27 | 120 | 10.6 | 115 | 11.0 | 105 | 12.1 | 100 | 12.7 |
| 31 | 130 | 11.2 | 120 | 12.1 | 115 | 12.6 | 110 | 13.2 |
| 37 | 140 | 12.4 | 135 | 12.9 | 125 | 13.9 | 120 | 14.5 |
| 42 | 150 | 13.1 | 140 | 14.1 | 135 | 14.6 | 125 | 15.8 |
| 43 | 155 | 13.0 | 145 | 13.9 | 135 | 14.9 | 130 | 15.5 |
| 48 | 160 | 14.1 | 150 | 15.0 | 145 | 15.5 | 135 | 16.7 |
| 55 | 175 | 14.7 | 160 | 16.1 | 155 | 16.6 | 145 | 17.8 |
| 61 | 180 | 15.9 | 170 | 16.8 | 160 | 17.9 | 155 | 18.5 |

Minimum centre spacing of tendon anchorages

| Tendon | | Minimum centre spacing $a_c = b_c$ | | | | | |
|---|-----|------------------------------------|-----|-----|-----|-----|-----|
| $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 |
| $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 |
| CONA CMI SP 0106 | mm | 120 | 115 | 105 | 100 | 95 | 95 |
| CONA CMI SP 0206 | mm | 170 | 165 | 150 | 145 | 135 | 135 |
| CONA CMI SP 0306 | mm | 205 | 200 | 185 | 175 | 170 | 165 |
| CONA CMI SP 0406 | mm | 235 | 230 | 210 | 200 | 190 | 185 |
| CONA CMI SP 0506 | mm | 265 | 255 | 240 | 225 | 215 | 210 |
| CONA CMI SP 0606 | mm | 290 | 280 | 260 | 245 | 230 | 225 |
| CONA CMI SP 0706 | mm | 315 | 300 | 280 | 270 | 255 | 245 |
| CONA CMI SP 0806 | mm | 335 | 320 | 300 | 285 | 270 | 260 |
| CONA CMI SP 0906 | mm | 355 | 340 | 315 | 300 | 285 | 275 |
| CONA CMI SP 1206 | mm | 410 | 395 | 365 | 345 | 330 | 320 |
| CONA CMI SP 1306 | mm | 425 | 410 | 380 | 360 | 340 | 330 |
| CONA CMI SP 1506 | mm | 455 | 440 | 410 | 390 | 370 | 360 |
| CONA CMI SP 1606 | mm | 470 | 455 | 420 | 400 | 380 | 370 |
| CONA CMI SP 1906 | mm | 510 | 490 | 455 | 435 | 415 | 405 |
| CONA CMI SP 2206 | mm | 550 | 530 | 490 | 465 | 445 | 435 |
| CONA CMI SP 2406 | mm | 575 | 550 | 515 | 485 | 465 | 455 |
| CONA CMI SP 2506 | mm | 585 | 565 | 520 | 495 | 470 | 460 |
| CONA CMI SP 2706 | mm | 605 | 585 | 540 | 515 | 490 | 480 |
| CONA CMI SP 3106 | mm | 650 | 625 | 580 | 555 | 535 | 520 |
| CONA CMI SP 3706 | mm | 715 | 715 | 715 | 715 | 715 | 715 |
| CONA CMI SP 4206 | mm | 765 | 765 | 765 | 765 | 765 | 765 |
| CONA CMI SP 4306 | mm | 775 | 775 | 775 | 775 | 775 | 775 |
| CONA CMI SP 4806 | mm | 830 | 830 | 830 | 830 | 830 | 830 |
| CONA CMI SP 5506 | mm | 905 | 905 | 905 | 905 | 905 | 905 |
| CONA CMI SP 6106 | mm | 960 | 960 | 960 | 960 | 960 | 960 |




Internal Post-tensioning System
Minimum centre spacing

Annex 13
of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy

| Minimum edge distance of tendon anchorages | | | | | | | |
|---|-----|------------------------------------|---------|---------|---------|---------|---------|
| Tendon | | Minimum centre spacing $a_c = b_c$ | | | | | |
| $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 |
| $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 |
| CONA CMI SP 0106 | mm | 50 + c | 50 + c | 45 + c | 40 + c | 40 + c | 40 + c |
| CONA CMI SP 0206 | mm | 75 + c | 75 + c | 65 + c | 65 + c | 60 + c | 60 + c |
| CONA CMI SP 0306 | mm | 95 + c | 90 + c | 85 + c | 80 + c | 75 + c | 75 + c |
| CONA CMI SP 0406 | mm | 110 + c | 105 + c | 95 + c | 90 + c | 85 + c | 85 + c |
| CONA CMI SP 0506 | mm | 125 + c | 120 + c | 110 + c | 105 + c | 100 + c | 95 + c |
| CONA CMI SP 0606 | mm | 135 + c | 130 + c | 120 + c | 115 + c | 105 + c | 105 + c |
| CONA CMI SP 0706 | mm | 150 + c | 140 + c | 130 + c | 125 + c | 120 + c | 115 + c |
| CONA CMI SP 0806 | mm | 160 + c | 150 + c | 140 + c | 135 + c | 125 + c | 120 + c |
| CONA CMI SP 0906 | mm | 170 + c | 160 + c | 150 + c | 140 + c | 135 + c | 130 + c |
| CONA CMI SP 1206 | mm | 195 + c | 190 + c | 175 + c | 165 + c | 155 + c | 150 + c |
| CONA CMI SP 1306 | mm | 205 + c | 195 + c | 180 + c | 170 + c | 160 + c | 155 + c |
| CONA CMI SP 1506 | mm | 220 + c | 210 + c | 195 + c | 185 + c | 175 + c | 170 + c |
| CONA CMI SP 1606 | mm | 225 + c | 220 + c | 200 + c | 190 + c | 180 + c | 175 + c |
| CONA CMI SP 1906 | mm | 245 + c | 235 + c | 220 + c | 210 + c | 200 + c | 195 + c |
| CONA CMI SP 2206 | mm | 265 + c | 255 + c | 235 + c | 225 + c | 215 + c | 210 + c |
| CONA CMI SP 2406 | mm | 280 + c | 265 + c | 250 + c | 235 + c | 225 + c | 220 + c |
| CONA CMI SP 2506 | mm | 285 + c | 275 + c | 250 + c | 240 + c | 225 + c | 220 + c |
| CONA CMI SP 2706 | mm | 295 + c | 285 + c | 260 + c | 250 + c | 235 + c | 230 + c |
| CONA CMI SP 3106 | mm | 315 + c | 305 + c | 280 + c | 270 + c | 260 + c | 250 + c |
| CONA CMI SP 3706 | mm | 350 + c | 350 + c | 350 + c | 350 + c | 350 + c | 350 + c |
| CONA CMI SP 4206 | mm | 375 + c | 375 + c | 375 + c | 375 + c | 375 + c | 375 + c |
| CONA CMI SP 4306 | mm | 380 + c | 380 + c | 380 + c | 380 + c | 380 + c | 380 + c |
| CONA CMI SP 4806 | mm | 405 + c | 405 + c | 405 + c | 405 + c | 405 + c | 405 + c |
| CONA CMI SP 5506 | mm | 445 + c | 445 + c | 445 + c | 445 + c | 445 + c | 445 + c |
| CONA CMI SP 6106 | mm | 470 + c | 470 + c | 470 + c | 470 + c | 470 + c | 470 + c |

c..... Concrete cover in mm

| | | |
|---|---|---|
|  | Internal Post-tensioning System Minimum edge distance | Annex 14 of European Technical Assessment ETA-09/0287 of 19.09.2018 |
|---|---|---|

electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy


| Maximum prestressing and oversteering forces | | | | | | | | | |
|---|--------|--|--------|---------|--------|---|--------|---------|-------|
| | | Maximum prestressing force ¹⁾ $0.9 \cdot F_{p0.1}$ | | | | Maximum oversteering force ^{1), 2)} $0.95 \cdot F_{p0.1}$ | | | |
| Designation | | CONA CMI SP | | | | | | | |
| | | n06-140 | | n06-150 | | n06-140 | | n06-150 | |
| Characteristic tensile strength | MPa | 1 770 | 1 860 | 1 770 | 1 860 | 1 770 | 1 860 | 1 770 | 1 860 |
| — | — | kN | kN | kN | kN | kN | kN | kN | kN |
| n Number of strands | 01 | 196 | 206 | 211 | 221 | 207 | 218 | 222 | 234 |
| | 02 | 392 | 412 | 421 | 443 | 414 | 435 | 445 | 467 |
| | 03 | 589 | 618 | 632 | 664 | 621 | 653 | 667 | 701 |
| | 04 | 785 | 824 | 842 | 886 | 828 | 870 | 889 | 935 |
| | 05 | 981 | 1 031 | 1 053 | 1 107 | 1 036 | 1 088 | 1 112 | 1 169 |
| | 06 | 1 177 | 1 237 | 1 264 | 1 328 | 1 243 | 1 305 | 1 334 | 1 402 |
| | 07 | 1 373 | 1 443 | 1 474 | 1 550 | 1 450 | 1 523 | 1 556 | 1 636 |
| | 08 | 1 570 | 1 649 | 1 685 | 1 771 | 1 657 | 1 740 | 1 778 | 1 870 |
| | 09 | 1 766 | 1 855 | 1 895 | 1 993 | 1 864 | 1 958 | 2 001 | 2 103 |
| | 12 | 2 354 | 2 473 | 2 527 | 2 657 | 2 485 | 2 611 | 2 668 | 2 804 |
| | 13 | 2 551 | 2 679 | 2 738 | 2 878 | 2 692 | 2 828 | 2 890 | 3 038 |
| | 15 | 2 943 | 3 092 | 3 159 | 3 321 | 3 107 | 3 263 | 3 335 | 3 506 |
| | 16 | 3 139 | 3 298 | 3 370 | 3 542 | 3 314 | 3 481 | 3 557 | 3 739 |
| | 19 | 3 728 | 3 916 | 4 001 | 4 207 | 3 935 | 4 133 | 4 224 | 4 440 |
| | 22 | 4 316 | 4 534 | 4 633 | 4 871 | 4 556 | 4 786 | 4 891 | 5 141 |
| | 24 | 4 709 | 4 946 | 5 054 | 5 314 | 4 970 | 5 221 | 5 335 | 5 609 |
| | 25 | 4 905 | 5 153 | 5 265 | 5 535 | 5 178 | 5 439 | 5 558 | 5 843 |
| | 27 | 5 297 | 5 565 | 5 686 | 5 978 | 5 592 | 5 874 | 6 002 | 6 310 |
| | 31 | 6 082 | 6 389 | 6 529 | 6 863 | 6 420 | 6 744 | 6 891 | 7 245 |
| | 37 | 7 259 | 7 626 | 7 792 | 8 192 | 7 663 | 8 049 | 8 225 | 8 647 |
| 42 | 8 240 | 8 656 | 8 845 | 9 299 | 8 698 | 9 137 | 9 337 | 9 815 | |
| 43 | 8 437 | 8 862 | 9 056 | 9 520 | 8 905 | 9 355 | 9 559 | 10 049 | |
| 48 | 9 418 | 9 893 | 10 109 | 10 627 | 9 941 | 10 442 | 10 670 | 11 218 | |
| 55 | 10 791 | 11 336 | 11 583 | 12 177 | 11 391 | 11 965 | 12 227 | 12 854 | |
| 61 | 11 968 | 12 572 | 12 847 | 13 505 | 12 633 | 13 271 | 13 560 | 14 256 | |

- 1) The given values are maximum values according to Eurocode 2. The actual values are taken from the standards and regulations in force at the place of use. Conformity with the stabilisation and crack width criteria in the load transfer test has been verified to a load level of $0.80 \cdot F_{pk}$.
- 2) Oversteering is permitted if the force in the prestressing jack is measured to an accuracy of $\pm 5\%$ of the final value of the prestressing force.


Where

F_{pk}Characteristic value of maximum force of tendon

$F_{p0.1}$...Characteristic value of 0.1% proof force of the tendon

| | | |
|---|--|---|
|  | Internal Post-tensioning System Maximum prestressing and oversteering forces | Annex 16 of European Technical Assessment ETA-09/0287 of 19.09.2018 |
|---|--|---|

Stressing and fixed anchorage / coupler

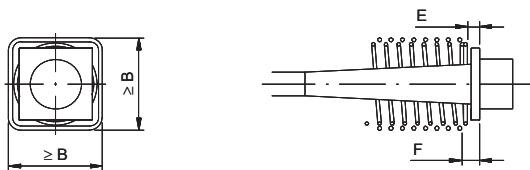


$$a_e = a'_e + c$$

$$b_e = b'_e + c$$

c ... Concrete cover

Centre spacing and edge distance

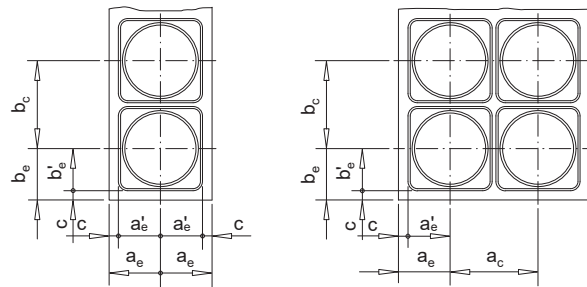

| BBR VT CONA CMI SP | 0206 | 0306 | 0406 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand

Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1860 MPa** ¹⁾

Tendon

| | | | 300 | 450 | 600 |
|----------------------------------|-----------------------|-----------------|-----|-----|-------|
| Cross-sectional area | A_p | mm ² | 300 | 450 | 600 |
| Char. value of maximum force | F_{pk} | kN | 558 | 837 | 1 116 |
| Char. value of 0.1 % proof force | $F_{p0.1}$ | kN | 492 | 738 | 984 |
| Max. prestressing force | $0.90 \cdot F_{p0.1}$ | kN | 443 | 664 | 886 |
| Maximum overstressing force | $0.95 \cdot F_{p0.1}$ | kN | 467 | 701 | 935 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

Minimum concrete strength

| Cube | $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
|----------|---|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | mm | 130 | 130 | 100 | 100 | 100 | 100 | 165 | 160 | 130 | 130 | 120 | 120 | 195 | 190 | 165 | 150 | 145 | 140 |
|----------------------|---|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | | mm | 130 | 130 | 100 | 100 | 100 | 100 | 165 | 160 | 130 | 130 | 120 | 120 | 195 | 190 | 165 | 150 | 145 | 140 |
| Bar diameter | | mm | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 |
| Length approximately | | mm | 145 | 145 | 123 | 123 | 123 | 123 | 168 | 168 | 145 | 145 | 145 | 145 | 190 | 190 | 168 | 168 | 168 | 168 |
| Pitch | | mm | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 |
| Number of pitches | | — | 4 | 4 | 3.5 | 3.5 | 3.5 | 3.5 | 4.5 | 4.5 | 4 | 4 | 4 | 4 | 5 | 5 | 4.5 | 4.5 | 4.5 | 4.5 |
| Distance | E | mm | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 25 | 25 | 25 | 25 | 25 | 25 |

Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | mm | 2 | 2 | 3 | 3 | 2 | 2 | 3 | 3 | 6 | 5 | 5 | 5 | 4 | 3 | 5 | 4 | 4 | 4 |
|----------------------------|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | | mm | 2 | 2 | 3 | 3 | 2 | 2 | 3 | 3 | 6 | 5 | 5 | 5 | 4 | 3 | 5 | 4 | 4 | 4 |
| Bar diameter | | mm | 6 | 6 | 6 | 6 | 6 | 6 | 10 | 10 | 8 | 8 | 8 | 8 | 10 | 10 | 10 | 10 | 10 | 10 |
| Spacing | | mm | 110 | 110 | 60 | 55 | 90 | 90 | 80 | 80 | 30 | 35 | 35 | 35 | 65 | 90 | 45 | 55 | 50 | 50 |
| Distance from anchor plate | F | mm | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 40 | 45 | 45 | 45 | 45 | 45 | 45 |
| Minimum outer dimensions | $B \times B$ | mm | 150 | 145 | 130 | 125 | 115 | 115 | 185 | 180 | 165 | 155 | 150 | 145 | 215 | 210 | 190 | 180 | 170 | 165 |

Centre spacing and edge distance

| | | mm | 170 | 165 | 150 | 145 | 135 | 135 | 205 | 200 | 185 | 175 | 170 | 165 | 235 | 230 | 210 | 200 | 190 | 185 |
|------------------------|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a_c, b_c | mm | 170 | 165 | 150 | 145 | 135 | 135 | 205 | 200 | 185 | 175 | 170 | 165 | 235 | 230 | 210 | 200 | 190 | 185 |
| Minimum edge distance | a'_e, b'_e | mm | 75 | 75 | 65 | 65 | 60 | 60 | 95 | 90 | 85 | 80 | 75 | 75 | 110 | 105 | 95 | 90 | 85 | 85 |

Square plate dimensions ²⁾

| | | mm | 140 | 140 | 140 | 140 | 135 | 135 | 145 | 145 | 145 | 140 | 140 | 140 | 155 | 155 | 155 | 155 | 150 | 150 |
|-------------|----------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S_{SP} | mm | 140 | 140 | 140 | 140 | 135 | 135 | 145 | 145 | 145 | 140 | 140 | 140 | 155 | 155 | 155 | 155 | 150 | 150 |
| Thickness | T_{SP} | mm | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 25 | 25 | 25 | 25 | 25 | 25 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1860 MPa may also be used.


²⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.



Internal Post-tensioning System
Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
Square plate dimensions

Annex 19
of European Technical Assessment
ETA-09/0287 of 19.09.2018

Stressing and fixed anchorage / coupler

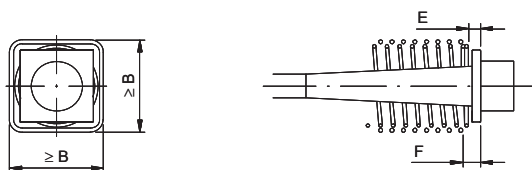


$$a_e = a'_e + c$$

$$b_e = b'_e + c$$

c ... Concrete cover

Centre spacing and edge distance

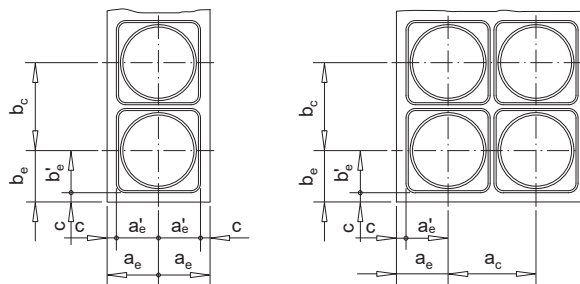

| BBR VT CONA CMI SP | 0506 | 0606 | 0706 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand

Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1860 MPa** ¹⁾

Tendon

| | | | 0506 | 0606 | 0706 |
|----------------------------------|--------------------------|-----------------|------|------|------|
| Cross-sectional area | A _p | mm ² | 750 | 900 | 1050 |
| Char. value of maximum force | F _{pk} | kN | 1395 | 1674 | 1953 |
| Char. value of 0.1 % proof force | F _{p0.1} | kN | 1230 | 1476 | 1722 |
| Maxi. prestressing force | 0.90 · F _{p0.1} | kN | 1107 | 1328 | 1550 |
| Maximum overstressing force | 0.95 · F _{p0.1} | kN | 1169 | 1402 | 1636 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

Minimum concrete strength

| Cube | f _{cm, 0, cube, 150} | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
|----------|-------------------------------------|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cylinder | f _{cm, 0, cylinder, Ø 150} | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

Helix, ribbed reinforcing steel, R_e ≥ 500 MPa

| | | mm | 215 | 200 | 185 | 170 | 160 | 160 | 250 | 230 | 210 | 180 | 175 | 175 | 260 | 255 | 220 | 210 | 195 | 190 |
|----------------------|---|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | | mm | 215 | 200 | 185 | 170 | 160 | 160 | 250 | 230 | 210 | 180 | 175 | 175 | 260 | 255 | 220 | 210 | 195 | 190 |
| Bar diameter | | mm | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 10 | 12 | 12 | 12 | 12 | 10 | 10 | 12 | 12 | 12 | 12 |
| Length approximately | | mm | 235 | 213 | 210 | 185 | 185 | 185 | 235 | 235 | 212 | 212 | 187 | 187 | 258 | 258 | 237 | 237 | 212 | 212 |
| Pitch | | mm | 45 | 45 | 50 | 50 | 50 | 50 | 45 | 45 | 50 | 50 | 50 | 50 | 45 | 45 | 50 | 50 | 50 | 50 |
| Number of pitches | | — | 6 | 5.5 | 5 | 4.5 | 4.5 | 4.5 | 6 | 6 | 5 | 5 | 4.5 | 4.5 | 6.5 | 6.5 | 5.5 | 5.5 | 5 | 5 |
| Distance | E | mm | 30 | 30 | 30 | 30 | 30 | 30 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 |

Additional reinforcement, ribbed reinforcing steel, R_e ≥ 500 MPa

| | | mm | 2 | 2 | 5 | 4 | 4 | 3 | 3 | 2 | 4 | 3 | 3 | 3 | 5 | 4 | 5 | 5 | 5 | 4 |
|----------------------------|-------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | | mm | 2 | 2 | 5 | 4 | 4 | 3 | 3 | 2 | 4 | 3 | 3 | 3 | 5 | 4 | 5 | 5 | 5 | 4 |
| Bar diameter | | mm | 12 | 12 | 10 | 10 | 10 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 | 12 |
| Spacing | | mm | 175 | 170 | 50 | 60 | 60 | 80 | 115 | 185 | 70 | 95 | 90 | 90 | 70 | 85 | 60 | 60 | 55 | 70 |
| Distance from anchor plate | F | mm | 50 | 50 | 50 | 50 | 50 | 50 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 |
| Minimum outer dimensions | B × B | mm | 245 | 235 | 220 | 205 | 195 | 190 | 270 | 260 | 240 | 225 | 210 | 205 | 295 | 280 | 260 | 250 | 235 | 225 |

Centre spacing and edge distance

| | | mm | 265 | 255 | 240 | 225 | 215 | 210 | 290 | 280 | 260 | 245 | 230 | 225 | 315 | 300 | 280 | 270 | 255 | 245 |
|------------------------|-----------------------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a _c , b _c | mm | 265 | 255 | 240 | 225 | 215 | 210 | 290 | 280 | 260 | 245 | 230 | 225 | 315 | 300 | 280 | 270 | 255 | 245 |
| Minimum edge distance | a' _e , b' _e | mm | 125 | 120 | 110 | 105 | 100 | 95 | 135 | 130 | 120 | 115 | 105 | 105 | 150 | 140 | 130 | 125 | 120 | 115 |

Square plate dimensions ²⁾

| | | mm | 185 | 185 | 185 | 185 | 180 | 180 | 190 | 190 | 190 | 190 | 185 | 185 | 205 | 205 | 205 | 200 | 195 | 195 |
|-------------|-----------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S _{SP} | mm | 185 | 185 | 185 | 185 | 180 | 180 | 190 | 190 | 190 | 190 | 185 | 185 | 205 | 205 | 205 | 200 | 195 | 195 |
| Thickness | T _{SP} | mm | 30 | 30 | 30 | 30 | 30 | 30 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 |

¹⁾ Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1860 MPa may also be used.


²⁾ The square plate dimensions are minimum values, therefore larger or thicker plates may be used.




Internal Post-tensioning System
 Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
 Square plate dimensions

Annex 20
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

Stressing and fixed anchorage / coupler

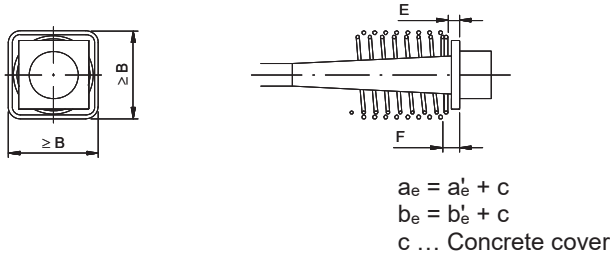

Centre spacing and edge distance

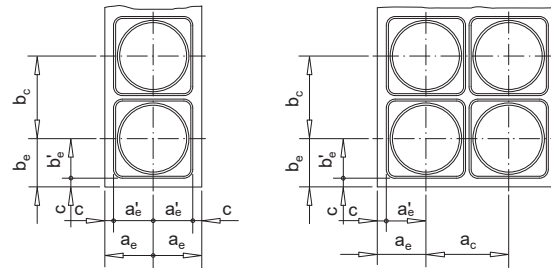

| BBR VT CONA CMI SP | 0806 | 0906 | 1206 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand
 Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1860 MPa** ¹⁾

| Tendon | | | |
|----------------------------------|-----------------------|-----------------|----------------------|
| Cross-sectional area | A_p | mm ² | 1200 1350 1800 |
| Char. value of maximum force | F_{pk} | kN | 2232 2511 3348 |
| Char. value of 0.1 % proof force | $F_{p0.1}$ | kN | 1968 2214 2952 |
| Max. prestressing force | $0.90 \cdot F_{p0.1}$ | kN | 1771 1993 2657 |
| Maximum overstressing force | $0.95 \cdot F_{p0.1}$ | kN | 1870 2103 2804 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

| Minimum concrete strength | | | | | | | | | | | | | | | | | | | | |
|---------------------------|---|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cube | $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

| Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa | | | | | | | | | | | | | | | | | | | |
|---|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | mm | 280 | 270 | 230 | 215 | 205 | 200 | 295 | 280 | 240 | 225 | 215 | 215 | 325 | 320 | 290 | 280 | 270 | 260 |
| Bar diameter ²⁾ | mm | 10 | 10 | 12 | 12 | 12 | 12 | 10 | 10 | 10 | 10 | 12 | 12 | 12 | 12 | 14 | 14 | 14 | 14 |
| Length approximately | mm | 280 | 258 | 237 | 237 | 237 | 212 | 280 | 280 | 260 | 260 | 262 | 212 | 327 | 327 | 312 | 289 | 289 | 239 |
| Pitch | mm | 45 | 45 | 50 | 50 | 50 | 50 | 45 | 45 | 50 | 50 | 50 | 50 | 45 | 45 | 50 | 50 | 50 | 50 |
| Number of pitches | — | 7 | 6.5 | 5.5 | 5.5 | 5.5 | 5 | 7 | 7 | 6 | 6 | 6 | 5 | 8 | 8 | 7 | 6.5 | 6.5 | 5.5 |
| Distance | E | mm | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 |

| Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa | | | | | | | | | | | | | | | | | | | |
|--|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | mm | 5 | 4 | 3 | 3 | 3 | 3 | 5 | 4 | 4 | 4 | 3 | 4 | 7 | 6 | 7 | 6 | 6 | 6 |
| Bar diameter ²⁾ | mm | 12 | 12 | 16 | 16 | 16 | 16 | 12 | 12 | 16 | 16 | 16 | 16 | 14 | 14 | 16 | 16 | 16 | 16 |
| Spacing | mm | 70 | 90 | 120 | 110 | 105 | 100 | 75 | 75 | 90 | 85 | 110 | 75 | 55 | 55 | 55 | 60 | 60 | 55 |
| Distance from anchor plate | F | mm | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 |
| Minimum outer dimensions | $B \times B$ | mm | 315 | 300 | 280 | 265 | 250 | 240 | 330 | 320 | 295 | 280 | 265 | 255 | 385 | 375 | 345 | 325 | 310 |

| Centre spacing and edge distance | | | | | | | | | | | | | | | | | | | |
|----------------------------------|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a_c, b_c | mm | 335 | 320 | 300 | 285 | 270 | 260 | 355 | 340 | 315 | 300 | 285 | 275 | 410 | 395 | 365 | 345 | 330 |
| Minimum edge distance | a'_e, b'_e | mm | 160 | 150 | 140 | 135 | 125 | 120 | 170 | 160 | 150 | 140 | 135 | 130 | 195 | 190 | 175 | 165 | 155 |


| Square plate dimensions ³⁾ | | | | | | | | | | | | | | | | | | | |
|---------------------------------------|----------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S_{SP} | mm | 225 | 225 | 225 | 220 | 215 | 215 | 255 | 255 | 250 | 245 | 240 | 240 | 265 | 265 | 265 | 260 | 255 |
| Thickness | T_{SP} | mm | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 | 35 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1860 MPa may also be used.
²⁾ ... Bar diameter of 14 mm can be replaced by 16 mm.
³⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.

| | | |
|--|---|--|
| | <p>Internal Post-tensioning System Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance Square plate dimensions</p> | <p>Annex 21 of European Technical Assessment ETA-09/0287 of 19.09.2018</p> |
|--|---|--|


electronic copy

Stressing and fixed anchorage / coupler

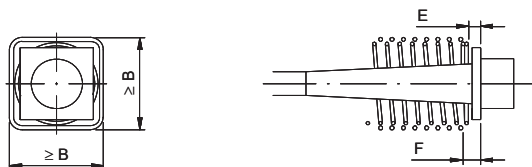

$a_e = a'_e + c$
 $b_e = b'_e + c$
 c ... Concrete cover

Centre spacing and edge distance

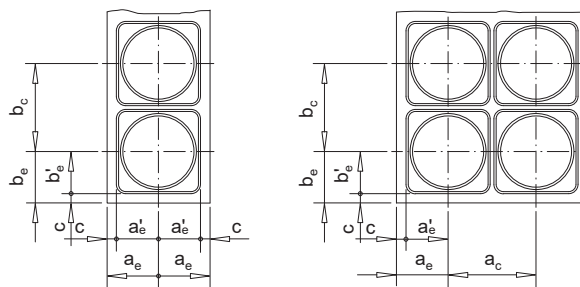

| | | | |
|---------------------------|-------------|-------------|-------------|
| BBR VT CONA CMI SP | 1306 | 1506 | 1606 |
| Strand arrangement | | | |

7-wire prestressing steel strand

Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1860 MPa** ¹⁾

Tendon

| | | | | | |
|----------------------------------|-----------------------|-----------------|------|------|------|
| Cross-sectional area | A_p | mm ² | 1950 | 2250 | 2400 |
| Char. value of maximum force | F_{pk} | kN | 3627 | 4185 | 4464 |
| Char. value of 0.1 % proof force | $F_{p0.1}$ | kN | 3198 | 3690 | 3936 |
| Max. prestressing force | $0.90 \cdot F_{p0.1}$ | kN | 2878 | 3321 | 3542 |
| Maximum overstressing force | $0.95 \cdot F_{p0.1}$ | kN | 3038 | 3506 | 3739 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

Minimum concrete strength

| | | | | | | | | | | | | | | | | | | | | |
|-----------------|---|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cube | $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | | | | | | | | | | | | | | | | | | |
|----------------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | mm | 340 | 330 | 305 | 290 | 280 | 270 | 370 | 350 | 325 | 300 | 290 | 280 | 390 | 370 | 340 | 330 | 310 | 310 |
| Bar diameter ²⁾ | mm | 12 | 12 | 12 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 | 14 |
| Length approximately | mm | 350 | 327 | 312 | 314 | 289 | 264 | 389 | 364 | 339 | 339 | 314 | 289 | 389 | 389 | 364 | 339 | 339 | 289 |
| Pitch | mm | 45 | 45 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| Number of pitches | — | 8.5 | 8 | 7 | 7 | 6.5 | 6 | 8.5 | 8 | 7.5 | 7.5 | 7 | 6.5 | 8.5 | 8.5 | 8 | 7.5 | 7.5 | 6.5 |
| Distance | E | mm | 40 | 40 | 40 | 40 | 40 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 |

Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | | | | | | | | | | | | | | | | | | |
|----------------------------|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | mm | 7 | 6 | 6 | 6 | 6 | 6 | 7 | 6 | 6 | 6 | 6 | 6 | 7 | 6 | 7 | 6 | 6 | 7 |
| Bar diameter ²⁾ | mm | 14 | 14 | 16 | 16 | 16 | 16 | 14 | 14 | 16 | 16 | 16 | 16 | 14 | 14 | 16 | 16 | 16 | 16 |
| Spacing | mm | 65 | 65 | 65 | 65 | 60 | 60 | 70 | 70 | 70 | 70 | 65 | 65 | 70 | 70 | 60 | 70 | 65 | 55 |
| Distance from anchor plate | F | mm | 60 | 60 | 60 | 60 | 60 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 | 65 |
| Minimum outer dimensions | $B \times B$ | mm | 405 | 390 | 360 | 340 | 320 | 310 | 435 | 420 | 390 | 370 | 350 | 340 | 450 | 435 | 400 | 380 | 360 |

Centre spacing and edge distance

| | | | | | | | | | | | | | | | | | | | |
|------------------------|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a_c, b_c | mm | 425 | 410 | 380 | 360 | 340 | 330 | 455 | 440 | 410 | 390 | 370 | 360 | 470 | 455 | 420 | 400 | 380 |
| Minimum edge distance | a'_e, b'_e | mm | 205 | 195 | 180 | 170 | 160 | 155 | 220 | 210 | 195 | 185 | 175 | 170 | 225 | 220 | 200 | 190 | 180 |

Square plate dimensions ³⁾

| | | | | | | | | | | | | | | | | | | | |
|-------------|----------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S_{SP} | mm | 285 | 285 | 280 | 275 | 270 | 270 | 320 | 320 | 315 | 310 | 305 | 300 | 330 | 330 | 325 | 320 | 315 |
| Thickness | T_{SP} | mm | 40 | 40 | 40 | 40 | 40 | 40 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 | 45 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1860 MPa may also be used.

²⁾ ... Bar diameter of 14 mm can be replaced by 16 mm.

³⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.




Internal Post-tensioning System
 Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
 Square plate dimensions

Annex 22
 of European Technical Assessment
ETA-09/0287 of 19.09.2018


electronic copy

Stressing and fixed anchorage / coupler

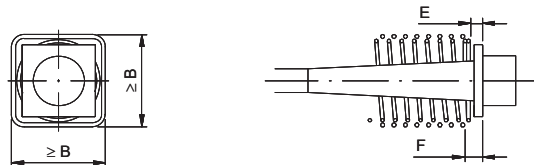

$a_e = a'_e + c$
 $b_e = b'_e + c$
 c ... Concrete cover

Centre spacing and edge distance

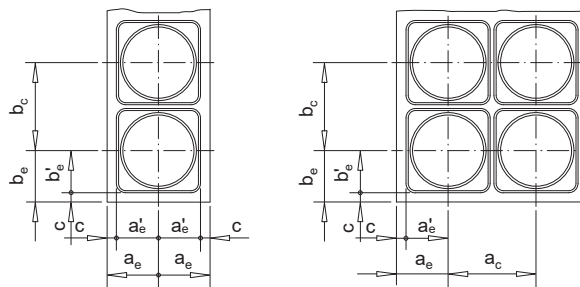

| BBR VT CONA CMI SP | 1906 | 2206 | 2406 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand

Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1860 MPa** ¹⁾

Tendon

| | | 1906 | 2206 | 2406 |
|---|-----------------|------|------|------|
| Cross-sectional area A_p | mm ² | 2850 | 3300 | 3600 |
| Char. value of maximum force F_{pk} | kN | 5301 | 6138 | 6696 |
| Char. value of 0.1 % proof force $F_{p0.1}$ | kN | 4674 | 5412 | 5904 |
| Max. prestressing force $0.90 \cdot F_{p0.1}$ | kN | 4207 | 4871 | 5314 |
| Maximum overstressing force $0.95 \cdot F_{p0.1}$ | kN | 4440 | 5141 | 5609 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

Minimum concrete strength

| Cube | $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
|----------|---|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | mm | 435 | 410 | 380 | 350 | 340 | 340 | 460 | 430 | 400 | 360 | 350 | 350 | 480 | 460 | 410 | 370 | 360 | 360 |
|----------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | mm | 435 | 410 | 380 | 350 | 340 | 340 | 460 | 430 | 400 | 360 | 350 | 350 | 480 | 460 | 410 | 370 | 360 | 360 |
| Bar diameter | mm | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 |
| Length approximately | mm | 391 | 391 | 391 | 366 | 341 | 291 | 441 | 441 | 416 | 391 | 366 | 316 | 466 | 441 | 416 | 416 | 391 | 341 |
| Pitch | mm | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| Number of pitches | — | 8.5 | 8.5 | 8.5 | 8 | 7.5 | 6.5 | 9.5 | 9.5 | 9 | 8.5 | 8 | 7 | 10 | 9.5 | 9 | 9 | 8.5 | 7.5 |
| Distance | E | 50 | 50 | 50 | 45 | 45 | 45 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 |

Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | mm | 7 | 6 | 9 | 8 | 7 | 7 | 7 | 6 | 9 | 8 | 8 | 7 | 7 | 6 | 9 | 8 | 8 | 7 |
|---------------------------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | mm | 7 | 6 | 9 | 8 | 7 | 7 | 7 | 6 | 9 | 8 | 8 | 7 | 7 | 6 | 9 | 8 | 8 | 7 |
| Bar diameter ³⁾ | mm | 14 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 20 | 20 | 20 | 20 | 20 | 20 |
| Spacing | mm | 70 | 85 | 50 | 55 | 60 | 55 | 80 | 80 | 55 | 60 | 55 | 55 | 90 | 100 | 70 | 70 | 70 | 80 |
| Distance from anchor plate | F | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 |
| Minimum outer dimensions $B \times B$ | mm | 490 | 470 | 435 | 415 | 395 | 385 | 530 | 510 | 470 | 445 | 425 | 415 | 550 | 530 | 495 | 465 | 445 | 435 |

Centre spacing and edge distance

| | mm | 510 | 490 | 455 | 435 | 415 | 405 | 550 | 530 | 490 | 465 | 445 | 435 | 575 | 550 | 515 | 485 | 465 | 455 |
|------------------------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing a_c, b_c | mm | 510 | 490 | 455 | 435 | 415 | 405 | 550 | 530 | 490 | 465 | 445 | 435 | 575 | 550 | 515 | 485 | 465 | 455 |
| Minimum edge distance a'_e, b'_e | mm | 245 | 235 | 220 | 210 | 200 | 195 | 265 | 255 | 235 | 225 | 215 | 210 | 280 | 265 | 250 | 235 | 225 | 220 |

Square plate dimensions ²⁾

| | mm | 340 | 340 | 335 | 325 | 320 | 310 | 370 | 370 | 365 | 355 | 345 | 345 | 390 | 390 | 385 | 375 | 370 | 370 |
|----------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length S_{SP} | mm | 340 | 340 | 335 | 325 | 320 | 310 | 370 | 370 | 365 | 355 | 345 | 345 | 390 | 390 | 385 | 375 | 370 | 370 |
| Thickness T_{SP} | mm | 50 | 50 | 50 | 45 | 45 | 45 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 | 55 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1860 MPa may also be used.

²⁾ ... Bar diameter of 14 mm can be replaced by 16 mm.


³⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.



Internal Post-tensioning System
 Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
 Square plate dimensions

Annex 23
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

Stressing and fixed anchorage / coupler

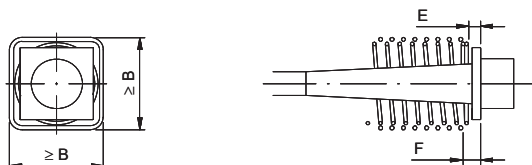


$$a_e = a'_e + c$$

$$b_e = b'_e + c$$

c ... Concrete cover

Centre spacing and edge distance

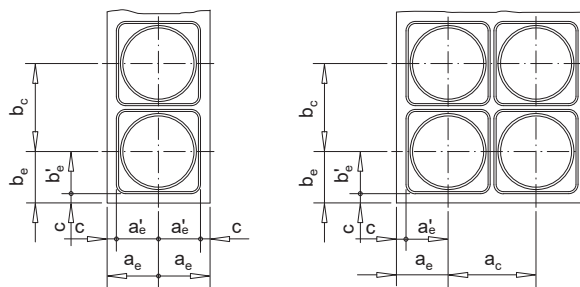

| BBR VT CONA CMI SP | 2506 | 2706 | 3106 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand

Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1 860 MPa** ¹⁾

Tendon

| | | | 2506 | 2706 | 3106 |
|----------------------------------|-----------------------|-----------------|-------|-------|-------|
| Cross-sectional area | A_p | mm ² | 3 750 | 4 050 | 4 650 |
| Char. value of maximum force | F_{pk} | kN | 6 975 | 7 533 | 8 649 |
| Char. value of 0.1 % proof force | $F_{p0.1}$ | kN | 6 150 | 6 642 | 7 626 |
| Max. prestressing force | $0.90 \cdot F_{p0.1}$ | kN | 5 535 | 5 978 | 6 863 |
| Maximum overstressing force | $0.95 \cdot F_{p0.1}$ | kN | 5 843 | 6 310 | 7 245 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

Minimum concrete strength

| Cube | $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
|----------|---|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | 500 | 480 | 420 | 380 | 370 | 370 | 520 | 500 | 450 | 400 | 390 | 380 | 560 | 540 | 480 | 430 | 430 | 430 |
|----------------------|------|-----|-----|-----|-----|-----|-----|------|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | mm | 500 | 480 | 420 | 380 | 370 | 370 | 520 | 500 | 450 | 400 | 390 | 380 | 560 | 540 | 480 | 430 | 430 | 430 |
| Bar diameter | mm | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 |
| Length approximately | mm | 466 | 466 | 441 | 441 | 391 | 366 | 491 | 491 | 441 | 441 | 416 | 391 | 516 | 516 | 466 | 466 | 416 | 391 |
| Pitch | mm | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| Number of pitches | — | 10 | 10 | 9.5 | 9.5 | 8.5 | 8 | 10.5 | 10.5 | 9.5 | 9.5 | 9 | 8.5 | 11 | 11 | 10 | 10 | 9 | 8.5 |
| Distance | E mm | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |

Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | 7 | 6 | 9 | 8 | 8 | 6 | 6 | 5 | 7 | 6 | 6 | 6 | 8 | 7 | 10 | 9 | 8 | 8 |
|----------------------------|----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | mm | 7 | 6 | 9 | 8 | 8 | 6 | 6 | 5 | 7 | 6 | 6 | 6 | 8 | 7 | 10 | 9 | 8 | 8 |
| Bar diameter | mm | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| Spacing | mm | 100 | 100 | 70 | 70 | 70 | 80 | 100 | 100 | 80 | 90 | 85 | 70 | 80 | 95 | 60 | 65 | 70 | 65 |
| Distance from anchor plate | F mm | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 | 80 |
| Minimum outer dimensions | B x B mm | 565 | 545 | 500 | 475 | 450 | 440 | 585 | 565 | 520 | 495 | 470 | 460 | 630 | 605 | 560 | 535 | 515 | 500 |

Centre spacing and edge distance

| | | 585 | 565 | 520 | 495 | 470 | 460 | 605 | 585 | 540 | 515 | 490 | 480 | 650 | 625 | 580 | 555 | 535 | 520 |
|------------------------|-----------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a_c, b_c mm | 585 | 565 | 520 | 495 | 470 | 460 | 605 | 585 | 540 | 515 | 490 | 480 | 650 | 625 | 580 | 555 | 535 | 520 |
| Minimum edge distance | a'_e, b'_e mm | 285 | 275 | 250 | 240 | 225 | 220 | 295 | 285 | 260 | 250 | 235 | 230 | 315 | 305 | 280 | 270 | 260 | 250 |

Square plate dimensions ²⁾

| | | 405 | 405 | 405 | 395 | 385 | 385 | 415 | 415 | 410 | 400 | 395 | 395 | 440 | 440 | 435 | 425 | 420 | 415 |
|-------------|-------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S_{SP} mm | 405 | 405 | 405 | 395 | 385 | 385 | 415 | 415 | 410 | 400 | 395 | 395 | 440 | 440 | 435 | 425 | 420 | 415 |
| Thickness | T_{SP} mm | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 | 60 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1 860 MPa may also be used.


²⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.



Internal Post-tensioning System
Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
Square plate dimensions


Annex 24
of European Technical Assessment
ETA-09/0287 of 19.09.2018

Stressing and fixed anchorage / coupler

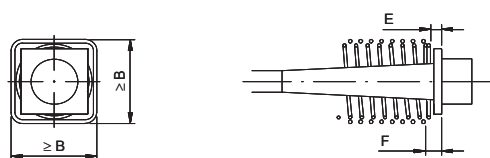

$a_e = a'_e + c$
 $b_e = b'_e + c$
 c ... Concrete cover

Centre spacing and edge distance

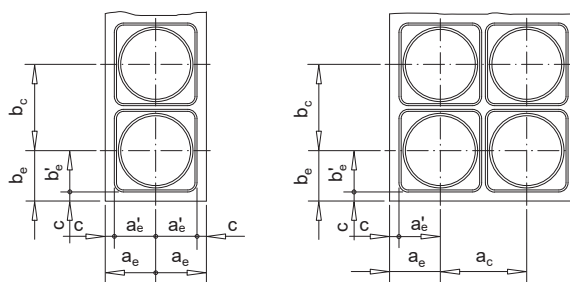

| BBR VT CONA CMI SP | 3706 | 4206 | 4306 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand

Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1860 MPa** ¹⁾

Tendon

| | | | 5550 | 6300 | 6450 |
|---|-----------------|--|-------|-------|-------|
| Cross-sectional area A_p | mm ² | | 5550 | 6300 | 6450 |
| Char. value of maximum force F_{pk} | kN | | 10323 | 11718 | 11997 |
| Char. value of 0.1 % proof force $F_{p0.1}$ | kN | | 9102 | 10332 | 10578 |
| Max. prestressing force $0.90 \cdot F_{p0.1}$ | kN | | 8192 | 9299 | 9520 |
| Maximum overstressing force $0.95 \cdot F_{p0.1}$ | kN | | 8647 | 9815 | 10049 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

Minimum concrete strength

| Cube | $f_{cm, 0, \text{cube}, 150}$ | MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
|----------|---|-----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ | MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | | | | | | | | | | | | | | | | | | | |
|----------------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | mm | 620 | 620 | 620 | 620 | 620 | 620 | 660 | 660 | 660 | 660 | 660 | 660 | 670 | 670 | 670 | 670 | 670 | 670 | 670 |
| Bar diameter | mm | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 |
| Length approximately | mm | 566 | 566 | 566 | 566 | 566 | 566 | 616 | 616 | 616 | 616 | 616 | 616 | 666 | 666 | 666 | 666 | 666 | 666 | 666 |
| Pitch | mm | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 | 50 |
| Number of pitches | — | 12 | 12 | 12 | 12 | 12 | 12 | 13 | 13 | 13 | 13 | 13 | 13 | 14 | 14 | 14 | 14 | 14 | 14 | 14 |
| Distance | E | mm | 70 | 70 | 70 | 70 | 70 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 |

Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa

| | | | | | | | | | | | | | | | | | | | | |
|----------------------------|-------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | mm | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 | 11 |
| Bar diameter | mm | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 | 20 |
| Spacing | mm | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 |
| Distance from anchor plate | F | mm | 90 | 90 | 90 | 90 | 90 | 95 | 95 | 95 | 95 | 95 | 95 | 95 | 95 | 95 | 95 | 95 | 95 | 95 |
| Minimum outer dimensions | B x B | mm | 695 | 695 | 695 | 695 | 695 | 745 | 745 | 745 | 745 | 745 | 745 | 745 | 755 | 755 | 755 | 755 | 755 | 755 |

Centre spacing and edge distance

| | | | | | | | | | | | | | | | | | | | | |
|------------------------|--------------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a_c, b_c | mm | 715 | 715 | 715 | 715 | 715 | 715 | 765 | 765 | 765 | 765 | 765 | 765 | 775 | 775 | 775 | 775 | 775 | 775 |
| Minimum edge distance | a'_e, b'_e | mm | 350 | 350 | 350 | 350 | 350 | 350 | 375 | 375 | 375 | 375 | 375 | 375 | 380 | 380 | 380 | 380 | 380 | 380 |

Square plate dimensions ²⁾

| | | | | | | | | | | | | | | | | | | | | |
|-------------|----------|----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S_{SP} | mm | 480 | 480 | 480 | 480 | 480 | 480 | 510 | 510 | 510 | 510 | 510 | 510 | 520 | 520 | 520 | 520 | 520 | 520 |
| Thickness | T_{SP} | mm | 70 | 70 | 70 | 70 | 70 | 70 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 | 75 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1860 MPa may also be used.

²⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.





Internal Post-tensioning System
 Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
 Square plate dimensions



Annex 25
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

Stressing and fixed anchorage / coupler

Centre spacing and edge distance



$a_e = a'_e + c$
 $b_e = b'_e + c$
 c ... Concrete cover



| BBR VT CONA CMI SP | 4806 | 5506 | 6106 |
|--------------------|------|------|------|
| Strand arrangement | | | |

7-wire prestressing steel strand
 Nominal diameter **15.7 mm** ... Nominal cross-sectional area **150 mm²** ... Maximum characteristic tensile strength **1 860 MPa** ¹⁾

| Tendon | | | | |
|----------------------------------|--------------------------|--------|--------|--------|
| Cross-sectional area | A_p mm ² | 7 200 | 8 250 | 9 150 |
| Char. value of maximum force | F_{pk} kN | 13 392 | 15 345 | 17 019 |
| Char. value of 0.1 % proof force | $F_{p0.1}$ kN | 11 808 | 13 530 | 15 006 |
| Max. prestressing force | $0.90 \cdot F_{p0.1}$ kN | 10 627 | 12 177 | 13 505 |
| Maximum overstressing force | $0.95 \cdot F_{p0.1}$ kN | 11 218 | 12 854 | 14 256 |

Minimum concrete strength / Helix / Additional reinforcement / Centre spacing and edge distance / Square plate dimensions

| Minimum concrete strength | | | | | | | | | | | | | | | | | | | |
|---------------------------|---|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|----|
| Cube | $f_{cm, 0, \text{cube}, 150}$ MPa | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 | 26 | 28 | 34 | 38 | 43 | 46 |
| Cylinder | $f_{cm, 0, \text{cylinder}, \varnothing 150}$ MPa | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 | 21 | 23 | 28 | 31 | 35 | 38 |

| Helix, ribbed reinforcing steel, $R_e \geq 500$ MPa | | | | | | | | | | | | | | | | | | | |
|---|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Outer diameter | mm | 720 | 720 | 720 | 720 | 720 | 720 | 790 | 790 | 790 | 790 | 790 | 790 | 860 | 860 | 860 | 860 | 860 | 860 |
| Bar diameter | mm | 20 | 20 | 20 | 20 | 20 | 20 | 25 | 25 | 25 | 25 | 25 | 25 | 25 | 25 | 25 | 25 | 25 | 25 |
| Length approximately | mm | 860 | 860 | 860 | 860 | 860 | 860 | 940 | 940 | 940 | 940 | 940 | 940 | 985 | 985 | 985 | 985 | 985 | 985 |
| Pitch | mm | 60 | 60 | 60 | 60 | 60 | 60 | 70 | 70 | 70 | 70 | 70 | 70 | 60 | 60 | 60 | 60 | 60 | 60 |
| Number of pitches | — | 15 | 15 | 15 | 15 | 15 | 15 | 14 | 14 | 14 | 14 | 14 | 14 | 17 | 17 | 17 | 17 | 17 | 17 |
| Distance | E mm | 80 | 80 | 80 | 80 | 80 | 80 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 |

| Additional reinforcement, ribbed reinforcing steel, $R_e \geq 500$ MPa | | | | | | | | | | | | | | | | | | | |
|--|----------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Number of stirrups | mm | 11 | 11 | 11 | 11 | 11 | 11 | 12 | 12 | 12 | 12 | 12 | 12 | 13 | 13 | 13 | 13 | 13 | 13 |
| Bar diameter | mm | 20 | 20 | 20 | 20 | 20 | 20 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 | 16 |
| Spacing | mm | 75 | 75 | 75 | 75 | 75 | 75 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 | 70 |
| Distance from anchor plate | F mm | 100 | 100 | 100 | 100 | 100 | 100 | 110 | 110 | 110 | 110 | 110 | 110 | 110 | 110 | 110 | 110 | 110 | 110 |
| Minimum outer dimensions | B x B mm | 810 | 810 | 810 | 810 | 810 | 810 | 885 | 885 | 885 | 885 | 885 | 885 | 940 | 940 | 940 | 940 | 940 | 940 |

| Centre spacing and edge distance | | | | | | | | | | | | | | | | | | | |
|----------------------------------|-----------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Minimum centre spacing | a_c, b_c mm | 830 | 830 | 830 | 830 | 830 | 830 | 905 | 905 | 905 | 905 | 905 | 905 | 960 | 960 | 960 | 960 | 960 | 960 |
| Minimum edge distance | a'_e, b'_e mm | 405 | 405 | 405 | 405 | 405 | 405 | 445 | 445 | 445 | 445 | 445 | 445 | 470 | 470 | 470 | 470 | 470 | 470 |

| Square plate dimensions ²⁾ | | | | | | | | | | | | | | | | | | | |
|---------------------------------------|-------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| Side length | S_{SP} mm | 550 | 550 | 550 | 550 | 550 | 550 | 595 | 595 | 595 | 595 | 595 | 595 | 620 | 620 | 620 | 620 | 620 | 620 |
| Thickness | T_{SP} mm | 80 | 80 | 80 | 80 | 80 | 80 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 | 90 |

¹⁾ ... Prestressing steel strand with nominal diameter of 15.3 mm, cross-sectional area of 140 mm² or with characteristic tensile strength below 1 860 MPa may also be used.
²⁾ ... The square plate dimensions are minimum values, therefore larger or thicker plates may be used.




Internal Post-tensioning System
 Minimum concrete strength – Helix – Additional reinforcement – Centre spacing and edge distance
 Square plate dimensions

Annex 26
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy

Centre spacing and edge distance

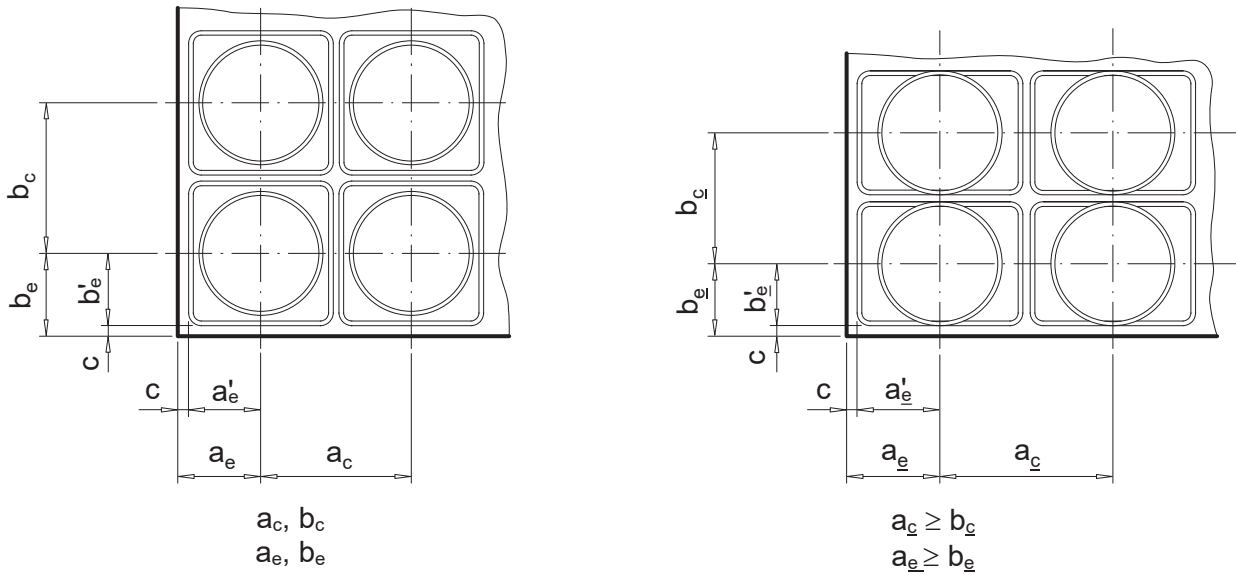

Modification of centre spacing and edge distance are in accordance with the Clauses 1.8 and 2.2.3.5.

$$b_c \begin{cases} \geq 0.85 \cdot b_c \\ \text{and} \\ \geq \text{Helix, outside diameter } ^1) \end{cases}$$

$$a_c \geq \frac{A_c}{b_c}$$

$$A_c = a_c \cdot b_c \leq a_c \cdot b_c$$

Corresponding edge distances

$$a_e = \frac{a_c}{2} - 10 \text{ mm} + c \quad \text{and} \quad b_e = \frac{b_c}{2} - 10 \text{ mm} + c$$

c..... Concrete cover

¹⁾.... Except the dimensions of helix, the outer dimensions of the additional reinforcement are adjusted accordingly. Further modifications of reinforcement are in accordance with Clause 2.2.3.5.

Contents of the prescribed test plan

| Subject / type of control | | Test or control method | Criteria, if any | Minimum number of samples | Minimum frequency of control |
|---|---------------------------------|------------------------|-------------------|---------------------------|--|
| Square plate | Material | Checking ¹⁾ | ²⁾ | 100 % | continuous |
| | Detailed dimensions | Testing | ²⁾ | 3 %, ≥ 2 specimens | continuous |
| | Visual inspection ³⁾ | Checking | ²⁾ | 100 % | continuous |
| | Traceability | bulk | | | |
| Anchor head, Coupler anchor head, Coupler sleeve | Material | Checking ⁴⁾ | ²⁾ | 100 % | continuous |
| | Detailed dimensions | Testing | ²⁾ | 5 %, ≥ 2 specimens | continuous |
| | Visual inspection ³⁾ | Checking | ²⁾ | 100 % | continuous |
| | Traceability | full | | | |
| Ring wedge | Material | Checking ⁴⁾ | ²⁾ | 100 % | continuous |
| | Treatment, hardness | Testing | ²⁾ | 0.5 %, ≥ 2 specimens | continuous |
| | Detailed dimensions | Testing | ²⁾ | 5 %, ≥ 2 specimens | continuous |
| | Visual inspection ³⁾ | Checking | ²⁾ | 100 % | continuous |
| | Traceability | full | | | |
| Strand | Material | Checking | ^{2), 5)} | 100 % | continuous |
| | Dimension | Testing | ²⁾ | 1 sample | each coil or every 7 tons ⁶⁾ |
| | Visual inspection | Checking | ²⁾ | 1 sample | |
| Steel strip duct | Material | Checking ⁷⁾ | ²⁾ | 100 % | continuous |
| | Dimension | Testing | ²⁾ | 3 %, ≥ 2 specimens | continuous |
| | Traceability | full | | | |
| Cement, admixtures, additions of filling materials as per EN 447 | Material | Checking ⁷⁾ | ²⁾ | 100 % | continuous |
| | Traceability | full | | | |

¹⁾ Checking by means of at least a test report 2.2 according to EN 10204.

²⁾ Conformity with the specifications of the component

³⁾ Successful visual inspection does not need to be documented.

⁴⁾ Checking by means of an inspection report 3.1 according to EN 10204.

⁵⁾ Checking of relevant certificate as long as the basis of "CE"-marking is not available.

⁶⁾ Maximum between a coil and 7 tons is taken into account

⁷⁾ Checking of relevant certificate, CE marking and declaration of performance or, if basis for CE marking is not available, certificate of supplier

Traceability full Full traceability of each component to its raw material.

Material Defined according to technical specification deposited by the supplier

Detailed dimension Measuring of all the dimensions and angles according to the specification given in the test plan

Visual inspection Main dimensions, correct marking and labelling, surface, corrosion, coating, etc.

Treatment, hardness Surface hardness, core hardness and treatment depth



CONA CMI SP

Internal Post-tensioning System
Contents of the prescribed test plan

Annex 31
of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy

Audit testing

| Subject / type of control | | Test or control method | Criteria, if any | Minimum number of samples ¹⁾ | Minimum frequency of control |
|--|-----------------------------------|---|------------------|---|------------------------------|
| Square plate | Material | Checking and testing, hardness and chemical ²⁾ | ³⁾ | 1 | 1/year |
| | Detailed dimensions | Testing | ³⁾ | 1 | 1/year |
| | Visual inspection | Checking | ³⁾ | 1 | 1/year |
| Anchor head, Coupler anchor head, Coupler sleeve | Material | Checking and testing, hardness and chemical ²⁾ | ³⁾ | 1 | 1/year |
| | Detailed dimensions | Testing | ³⁾ | 1 | 1/year |
| | Visual inspection | Checking | ³⁾ | 1 | 1/year |
| Ring wedge | Material | Checking and testing, hardness and chemical ²⁾ | ³⁾ | 2 | 1/year |
| | Treatment, hardness | Checking and testing, hardness profile | ³⁾ | 2 | 1/year |
| | Detailed dimensions | Testing | ³⁾ | 1 | 1/year |
| | Main dimensions, surface hardness | Testing | ³⁾ | 5 | 1/year |
| | Visual inspection | Checking | ³⁾ | 5 | 1/year |
| Single tensile element test | | According to EAD 160004-00-0301, Annex C.7 | | 1 series | 1/year |

1) If the kits comprise different kinds of anchor heads e.g. with different materials, different shape, different wedges, etc., then the number of samples are understood as per kind.

2) Testing of hardness and checking of chemical composition by means of an inspection report 3.1 according to EN 10204.

3) Conformity with the specifications of the components

Material Defined according to technical specification deposited by the ETA holder at the Notified body

Detailed dimension Measuring of all the dimensions and angles according to the specification given in the test plan

Visual inspection Main dimensions, correct marking and labelling, surface, corrosion, coating, etc.

Treatment, hardness Surface hardness, core hardness and treatment depth



Internal Post-tensioning System
 Audit testing

Annex 32
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy electronic copy

| № | Essential Characteristic | Clause | Intended use | | |
|----|--|---------|---|---|---|
| | | | Line № according to Clause 2.1, Table 8 | | |
| | | | 1 | 2 | 3 |
| 1 | Resistance to static load | 3.2.1.1 | + | + | + |
| 2 | Resistance to fatigue | 3.2.1.2 | + | + | + |
| 3 | Load transfer to the structure | 3.2.1.3 | + | + | + |
| 4 | Friction coefficient | 3.2.1.4 | + | + | + |
| 5 | Deviation, deflection (limits) for internal bonded and internal unbonded tendon | 3.2.1.5 | + | + | + |
| 6 | Assessment of assembly | 3.2.1.6 | + | + | + |
| 7 | Corrosion protection | 3.2.1.7 | + | + | + |
| 8 | Reaction to fire | 3.2.2.1 | + | + | + |
| 9 | Content, emission and/or release of dangerous substances | 3.2.3.1 | + | + | + |
| 10 | Resistance to static load under cryogenic conditions for applications with anchorage/ coupling outside the possible cryogenic zone | 3.2.4.1 | — | — | + |

Key

+.....Essential characteristic relevant for the intended use

—.....Essential characteristic not relevant for the intended use

For combinations of intended uses, the essential characteristics of all intended uses composing the combination are relevant.



CONA CMI SP

Internal Post-tensioning System
 Essential characteristics for the intended uses

Annex 33
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy

Reference documents

European Assessment Documents

| | |
|--------------------|---|
| EAD 160004-00-0301 | Post-Tensioning Kits for Prestressing of Structures |
| EAD 160027-00-0301 | Special filling products for post-tensioning kits |

Eurocodes

| | |
|------------|---|
| Eurocode 2 | Eurocode 2: Design of concrete structures |
| Eurocode 3 | Eurocode 3: Design of steel structures |
| Eurocode 6 | Eurocode 6: Design of masonry structures |

Standards

| | |
|------------------------|---|
| EN 206+A1, 11.2016 | Concrete – Specification, performance, production and conformity |
| EN 445, 10.2007 | Grout for prestressing tendons – Test methods |
| EN 446, 10.2007 | Grout for prestressing tendons – Grouting procedures |
| EN 447, 10.2007 | Grout for prestressing tendons – Basic requirements |
| EN 523, 08.2003 | Steel strip sheaths for prestressing tendons – Terminology, requirements, quality control |
| EN 10025-2, 11.2004 | Hot rolled products of structural steels – Part 2: Technical delivery conditions for non-alloy structural steels |
| EN 10025-2/AC, 06.2005 | |
| EN 10083-1, 08.2006 | Steels for quenching and tempering – Part 1: General technical delivery conditions |
| EN 10083-2, 08.2006 | Steels for quenching and tempering – Part 2: Technical delivery conditions for non alloy steels |
| EN 10084, 04.2008 | Case hardening steels – Technical delivery conditions |
| EN 10204, 10.2004 | Metallic products – Types of inspection documents |
| EN 10210-1, 04.2006 | Hot finished structural hollow sections of non-alloy and fine grain steels – Part 1: Technical delivery conditions |
| EN 10216-1, 12.2013 | Seamless steel tubes for pressure purposes – Technical delivery conditions – Part 1: Non-alloy steel tubes with specified room temperature properties |
| EN 10217-1, 05.2002 | Welded steel tubes for pressure purposes – Technical delivery conditions – Part 1: Non-alloy steel tubes with specified room temperature properties |
| EN 10217-1/A1, 01.2005 | |
| EN 10219-1, 04.2006 | Cold formed welded structural hollow sections of non-alloy and fine grain steels – Part 1: Technical delivery conditions |
| EN 10255+A1, 04.2007 | Non-Alloy steel tubes suitable for welding and threading – Technical delivery conditions |
| EN 10270-1, 10.2011 | Steel wire for mechanical springs – Part 1: Patented cold drawn unalloyed steel wire |



CONA CMI SP

Internal Post-tensioning System
 Reference documents

Annex 34
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

electronic copy

| | |
|-------------------------|---|
| EN 10277-2, 03.2008 | Bright steel products – Technical delivery conditions – Part 2: Steels for general engineering purposes |
| EN 10305-5, 01.2010 | Steel tubes for precision applications – Technical delivery conditions – Part 5: Welded cold sized square and rectangular tubes |
| EN ISO 17855-1, 10.2014 | Plastics – Polyethylene (PE) moulding and extrusion materials – Part 1: Designation system and basis for specifications |
| EN ISO 19069-1, 03.2015 | Plastics – Polypropylene (PP) moulding and extrusion materials – Part 1: Designation system and basis for specifications |
| prEN 10138-3, 09.2000 | Prestressing steels – Part 3: Strand |
| prEN 10138-3, 08.2009 | Prestressing steels – Part 3: Strand |
| CWA 14646, 01.2003 | Requirements for the installation of post-tensioning kits for prestressing of structures and qualification of the specialist company and its personnel |
| 98/456/EC | Commission decision 98/456/EC of 3 July 1998 on the procedure for attesting the conformity of construction products pursuant to Article 20 (2) of Council Directive 89/106/EEC as regards posttensioning kits for the prestressing of structures, Official Journal of the European Communities L 201 of 17 July 1998, p. 112 |
| 305/2011 | Regulation (EU) № 305/2011 of the European Parliament and of the Council of 9 March 2011 laying down harmonised conditions for the marketing of construction products and repealing Council Directive 89/106/EEC, OJ L 88 of 4 April 2011, p. 5, amended by Commission Delegated Regulation (EU) № 568/2014 of 18 February 2014, OJ L 157 of 27.05.2014, p. 76 and Commission Delegated Regulation (EU) № 574/2014 of 21 February 2014, OJ L 159 of 28.05.2014, p. 41 |
| 568/2014 | Commission Delegated Regulation (EU) № 568/2014 of 18 February 2014 amending Annex V to Regulation (EU) № 305/2011 of the European Parliament and of the Council as regards the assessment and verification of constancy of performance of construction products, OJ L 157 of 27.05.2014, p. 76 |



CONA CMI SP

Internal Post-tensioning System
 Reference documents

Annex 35
 of European Technical Assessment
ETA-09/0287 of 19.09.2018

Materialprüfungsamt Nordrhein-Westfalen

Prüfen • Überwachen • Zertifizieren

Certificate of constancy of performance

0432-CPR-00299-1.5 (EN)

Version 01

In compliance with Regulation (EU) No 305/2011 of the European Parliament and of the Council of 9 March 2011 (the Construction products Regulation or CPR), this certificate applies to the construction product

**BBR VT CONA CMI SP – Internal Post-tensioning System
with 01 to 61 Strands**

Bonded or unbonded post-tensioning kits for prestressing of structures with strands

placed on the market under the name or trade mark of

BBR VT International Ltd

Ringstrasse 2
8603 Schwerzenbach (ZH) / Switzerland

and produced in the manufacturing plant(s)

BBR VT International Ltd

Ringstrasse 2
8603 Schwerzenbach (ZH) / Switzerland

This certificate attests that all provisions concerning the assessment and verification of constancy of performance described in the

ETA-09/0287, issued on 19.09.2018

and

EAD 160004-00-0301

under **system 1+** for the performance set out in the ETA are applied and that the factory production control conducted by the manufacturer is assessed to ensure the

constancy of performance of the construction product.

This certificate was first issued on 30.07.2010 and will remain valid until 20.09.2023 as long as neither the ETA, the EAD, the construction product, the AVCP methods nor the manufacturing conditions in the plant are modified significantly, unless suspended or withdrawn by the notified product certification body.

Dortmund, 21.09.2018

by order


Dipl.-Ing. Hönig
Head of Certification Body (Dep. 21)



This Certificate consists of 1 page.

This Certificate replaces the Certificate no. 0432-CPD-11 9181-1.5/2 dated 30.06.2013.

The original of this document was issued in German language.
In case of doubt only the German version is valid.



second copy

BBR VT International Ltd

Ringstrasse 2
8603 Schwerzenbach (ZH)
Switzerland

Tel +41 44 806 80 60

Fax +41 44 806 80 50

www.bbrnetwork.com

info@bbrnetwork.com

BBR VT International Ltd

Technical Headquarters and Business Development Centre
Switzerland



A Global Network of Experts
www.bbrnetwork.com